



QUANTUM QA - HYDRAULIC SCHEMATICS

QVANTUM QA - HYDRAULIC SCHEMATICS


CONTENTS

Title	Drawing number	Page
<u>QA9/15 & QH175</u>		
QA9/15 & QH175, heating & hot water	QA9:15-56-8-001	4
QA9/15 & QH175, heating & hot water with external hot water tank	QA9:15-56-8-002	5
QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation	QA9:15-56-8-003	6
QA9/15 & QH175, Underfloor heating & hot water	QA9:15-56-8-004	7
QA9/15 & QH175, Underfloor heating & hot water with external hot water tank	QA9:15-56-8-005	8
QA9/15 & QH175, Underfloor heating & hot water with external hot water tank & hot water circulation	QA9:15-56-8-006	9
QA9/15 & QH175, heating & hot water, second heating system	QA9:15-56-8-007	10
QA9/15 & QH175, heating & hot water with external hot water tank, second heating system	QA9:15-56-8-008	11
QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, second heating system	QA9:15-56-8-009	12
QA9/15 & QH175, heating & hot water, external circulation pump, second heating system	QA9:15-56-8-010	13
QA9/15 & QH175, heating & hot water with external hot water tank, external circulation pump, second heating system	QA9:15-56-8-011	14
QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, external circulation pump, second heating system	QA9:15-56-8-012	15
QA9/15 & QH175, heating & hot water, external circulation pump, individual zone control	QA9:15-56-8-013	16
QA9/15 & QH175, heating & hot water with external hot water tank, external circulation pump, individual zone control	QA9:15-56-8-014	17
QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, external circulation pump, individual zone control	QA9:15-56-8-015	18
QA9/15 & QH175, 2-pipe cooling & hot water	QA9:15-55-8-001	19

QVANTUM QA9/15 & QH175

Information

QA9/15 & QH175, heating & hot water

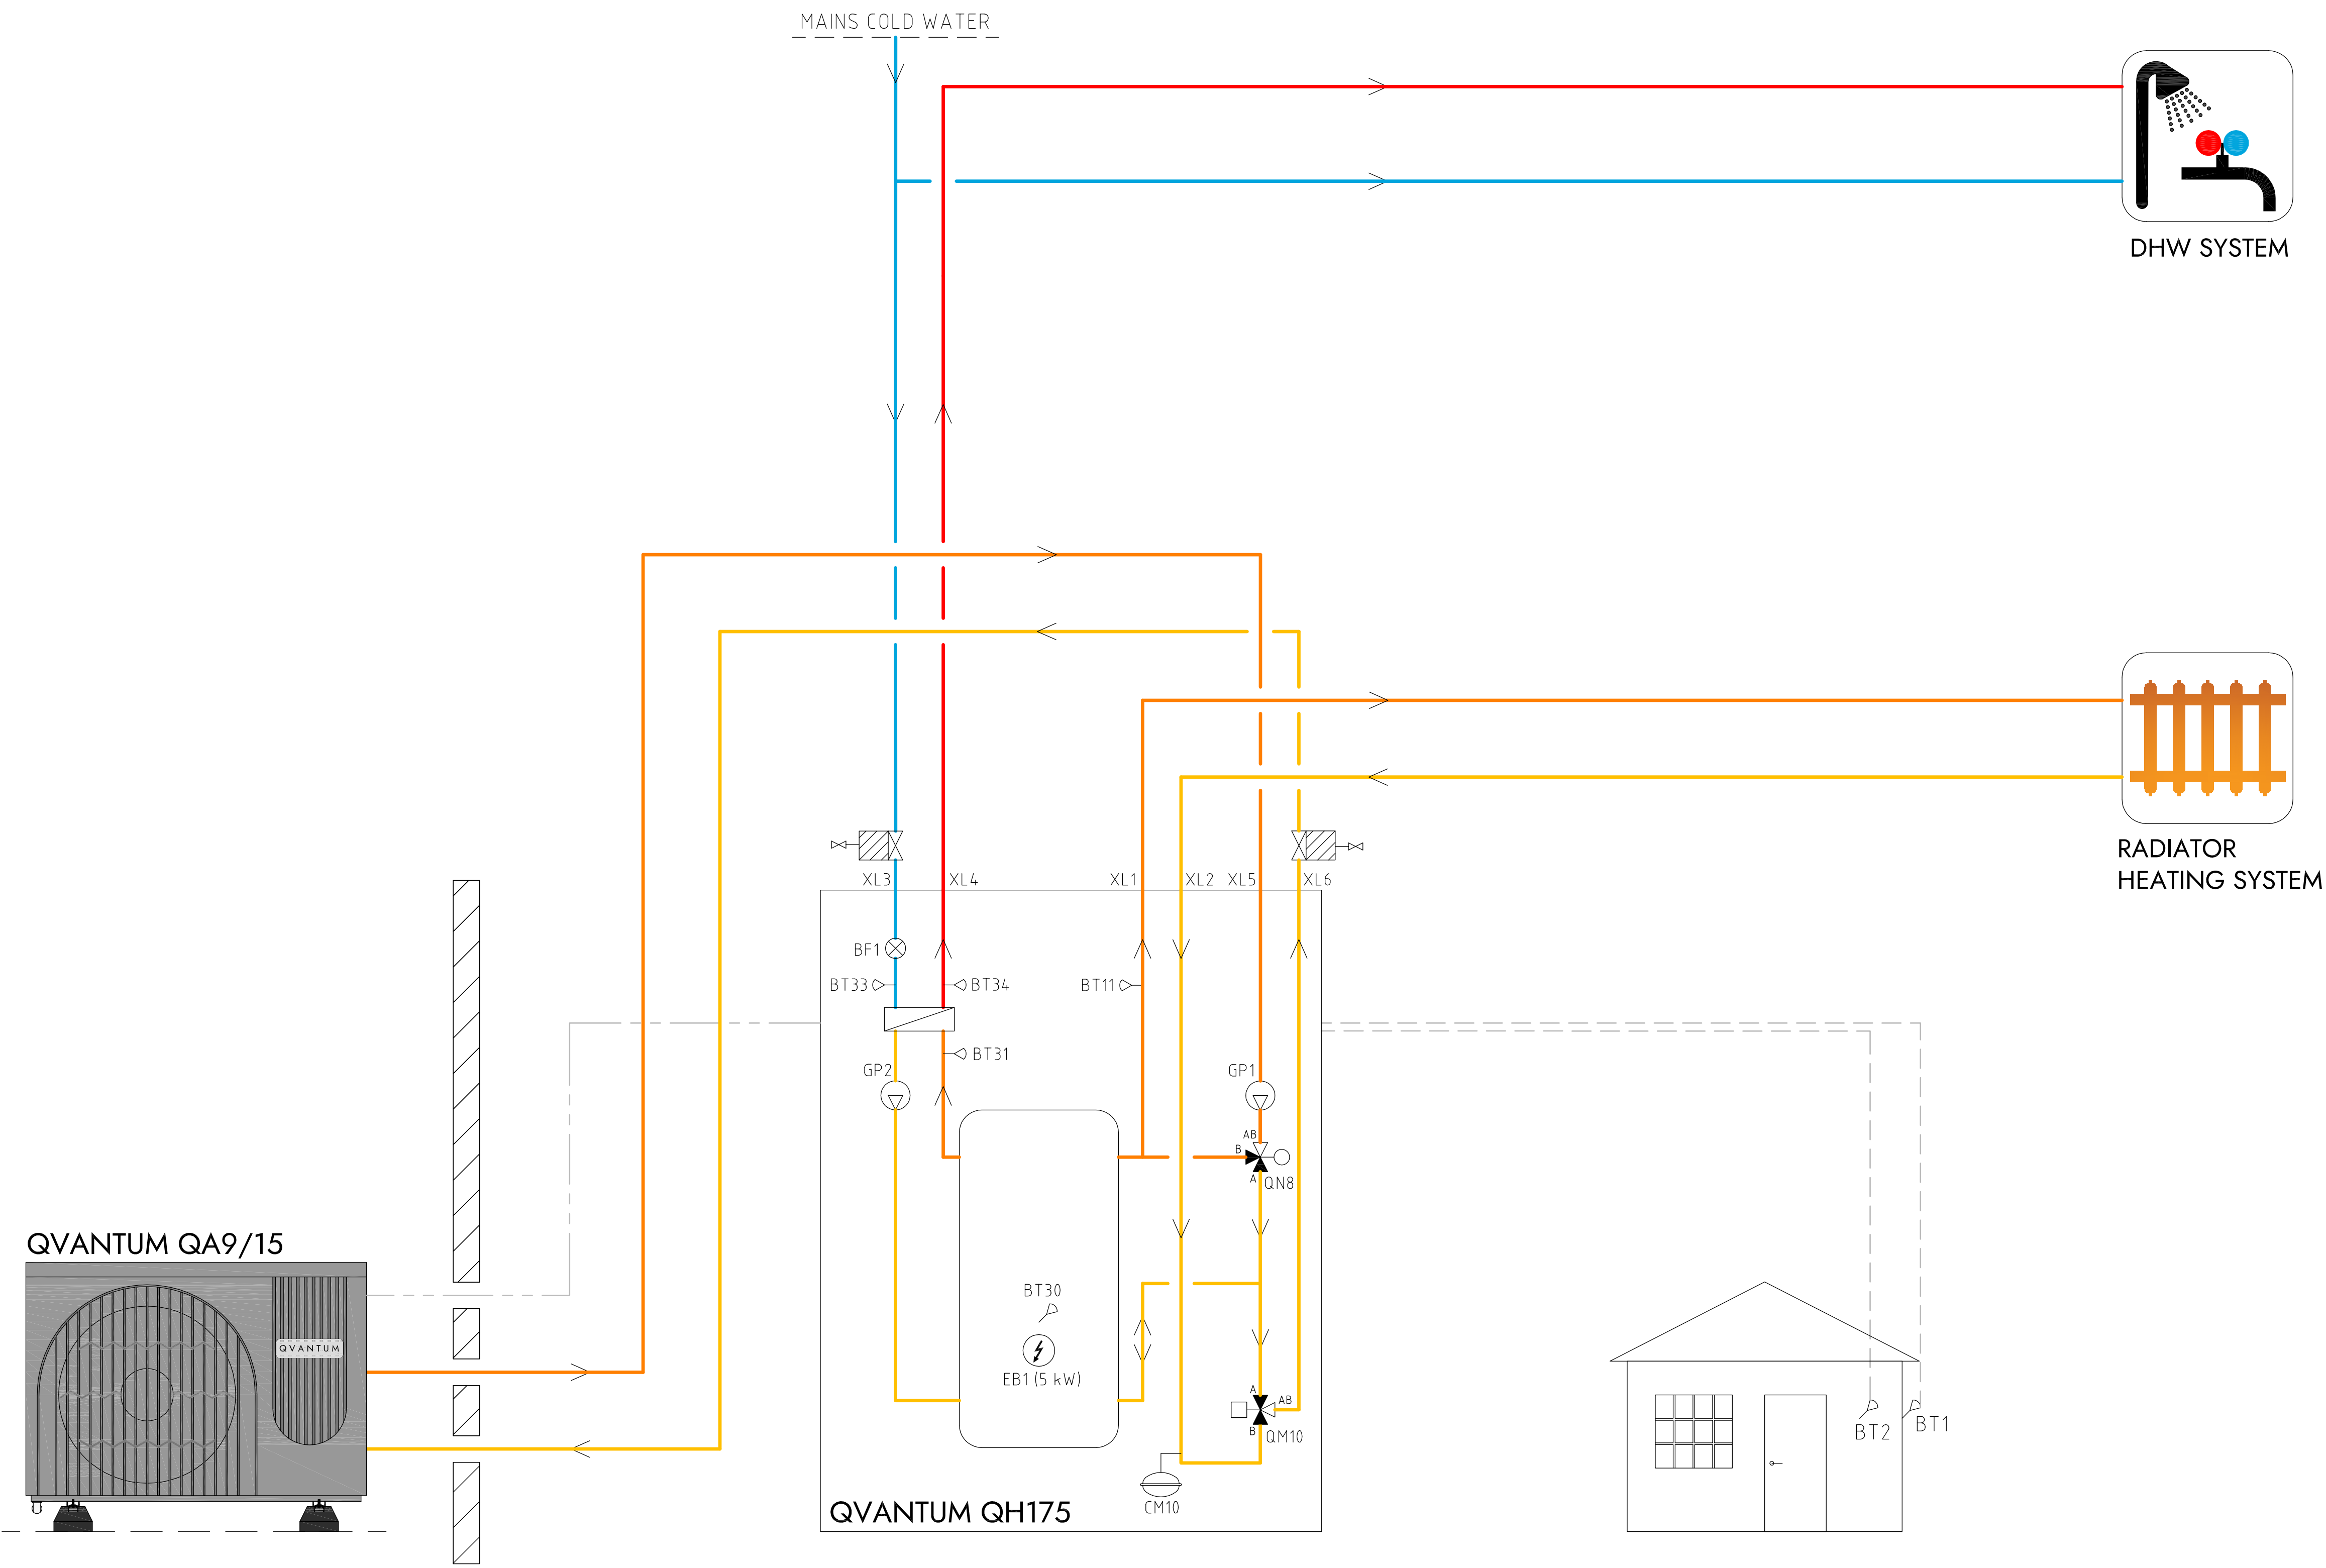

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QUANTUM QA9/15

QUANTUM QH175

RADIATOR
HEATING SYSTEM

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QUANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QUANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-001	PAGE NUMBER 4
----------------	-----------------------------------	------------------

Information

QA9/15 & QH175, heating & hot water with external hot water tank

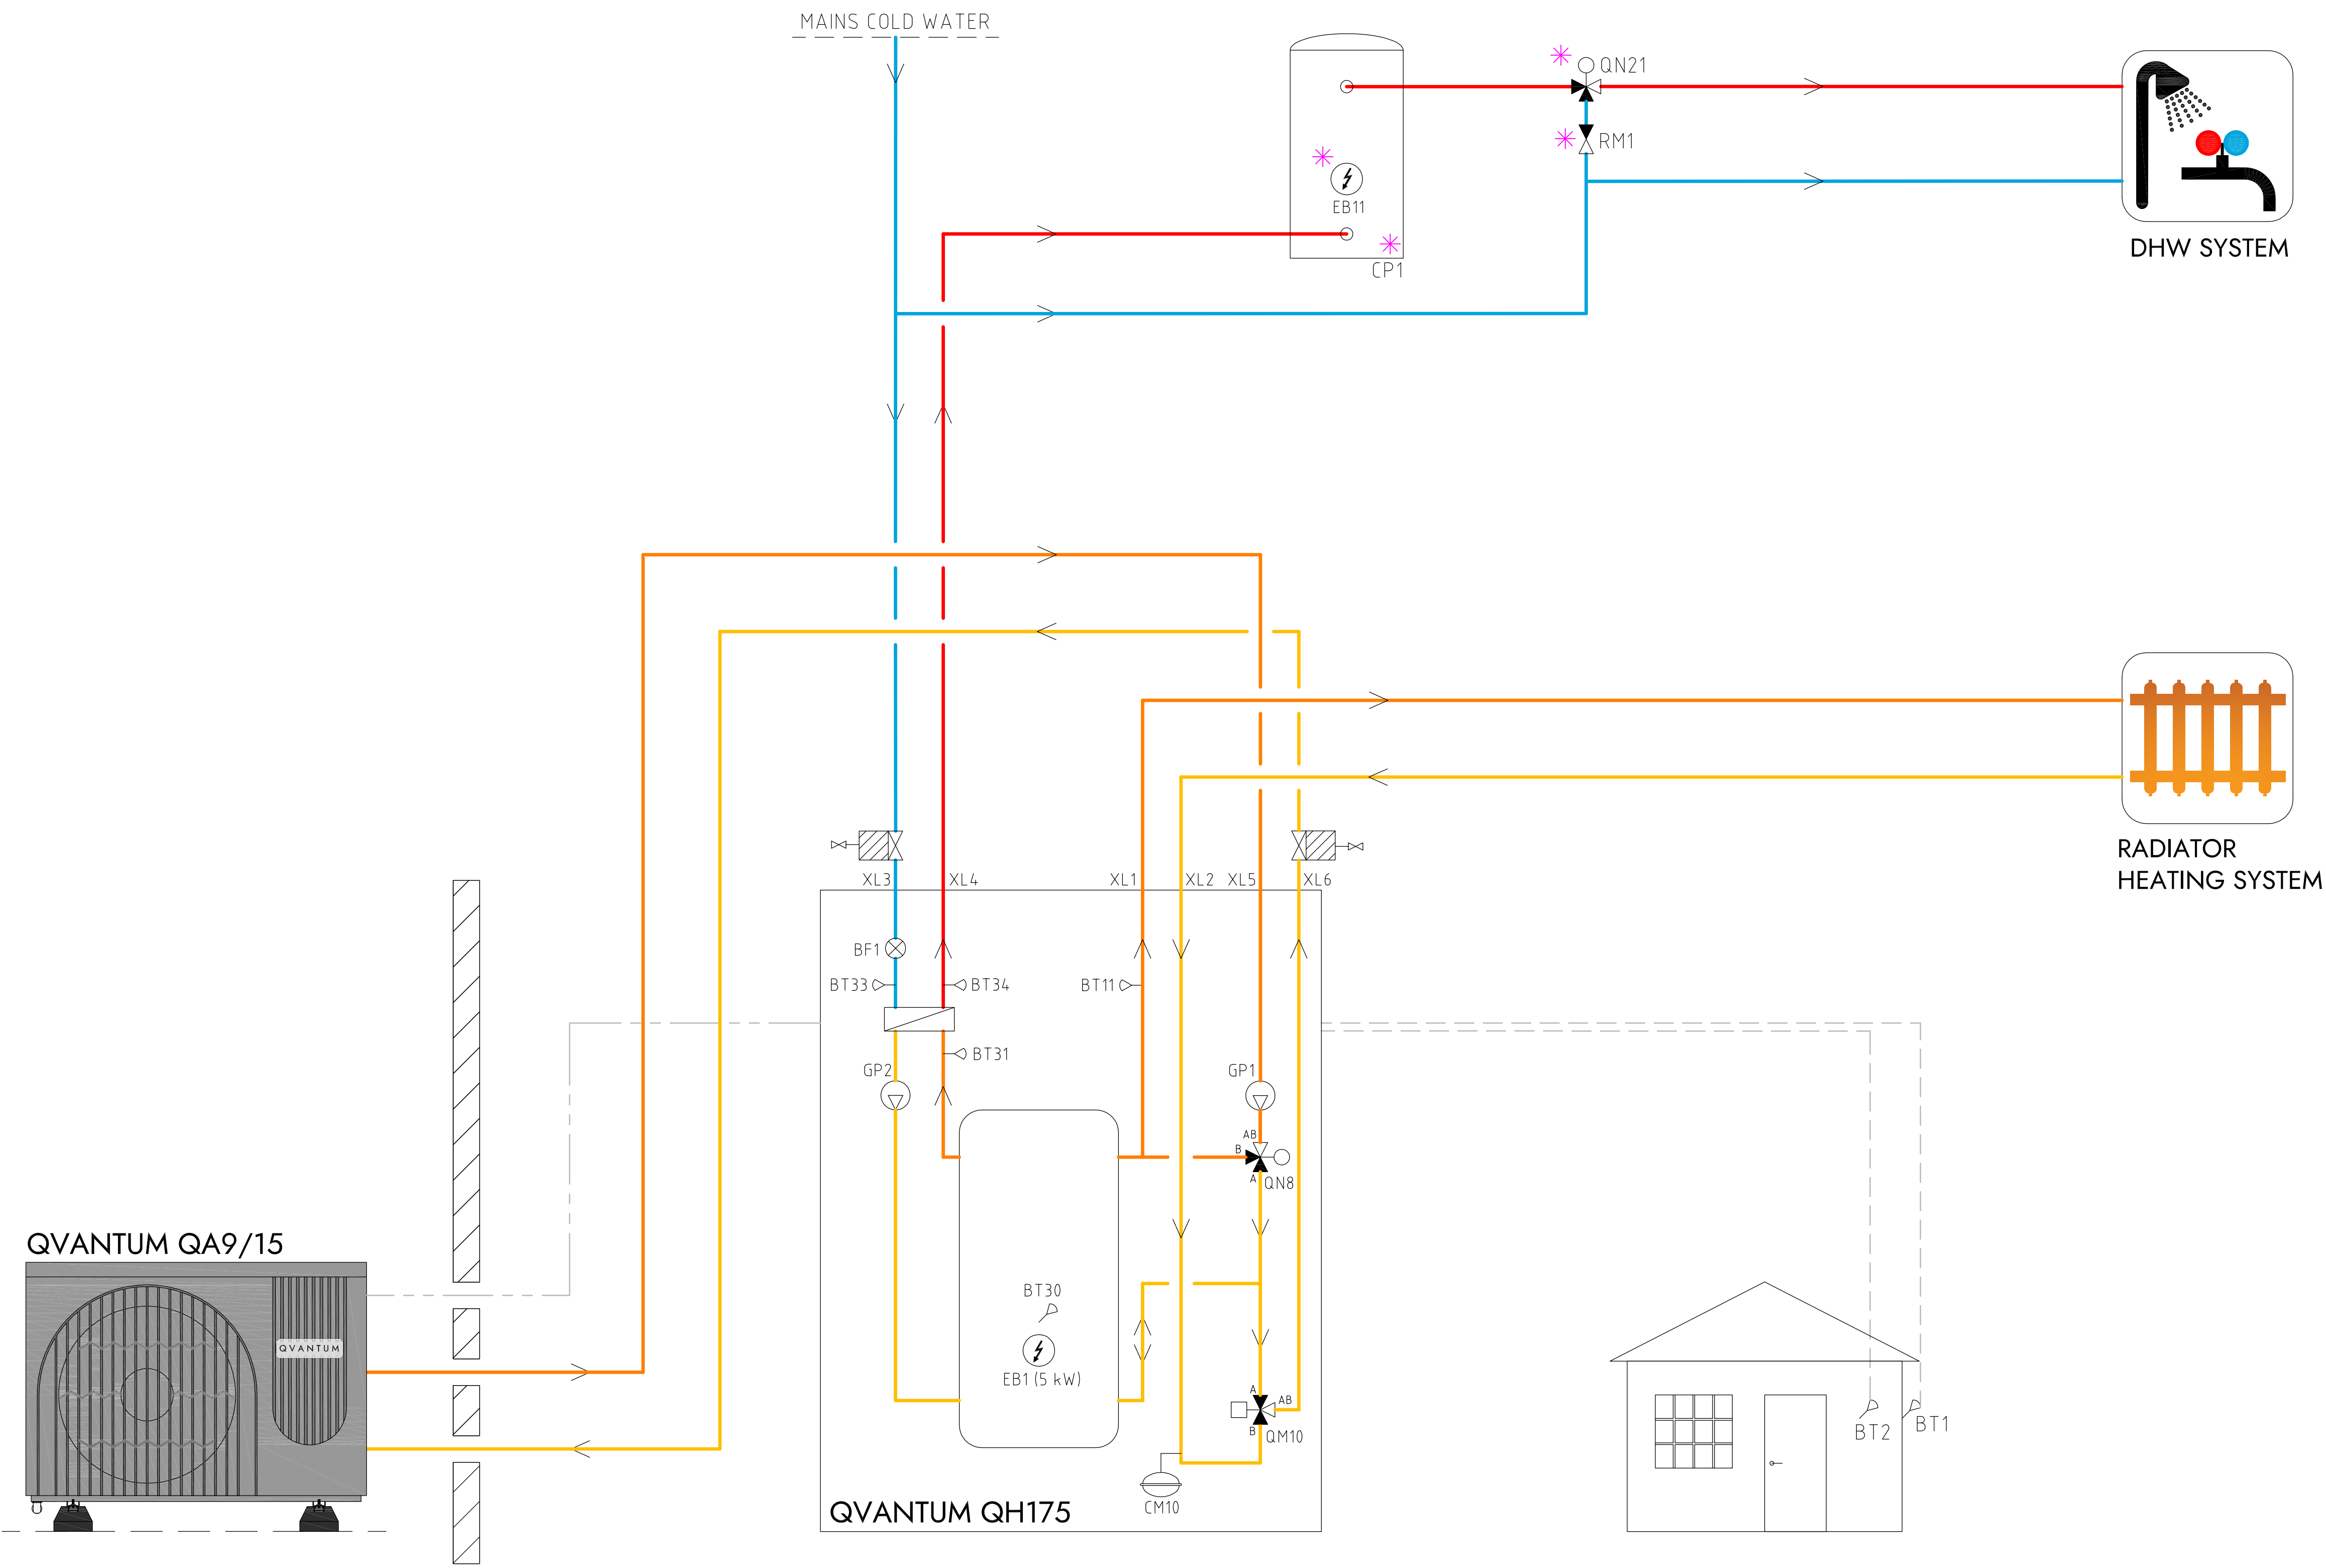

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
CP1	DHW cylinder
EB11	Immersion heater
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

RADIATOR HEATING SYSTEM

DHW SYSTEM

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.


QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-002	PAGE NUMBER 5
-----------------------	--	-------------------------

Information

QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation

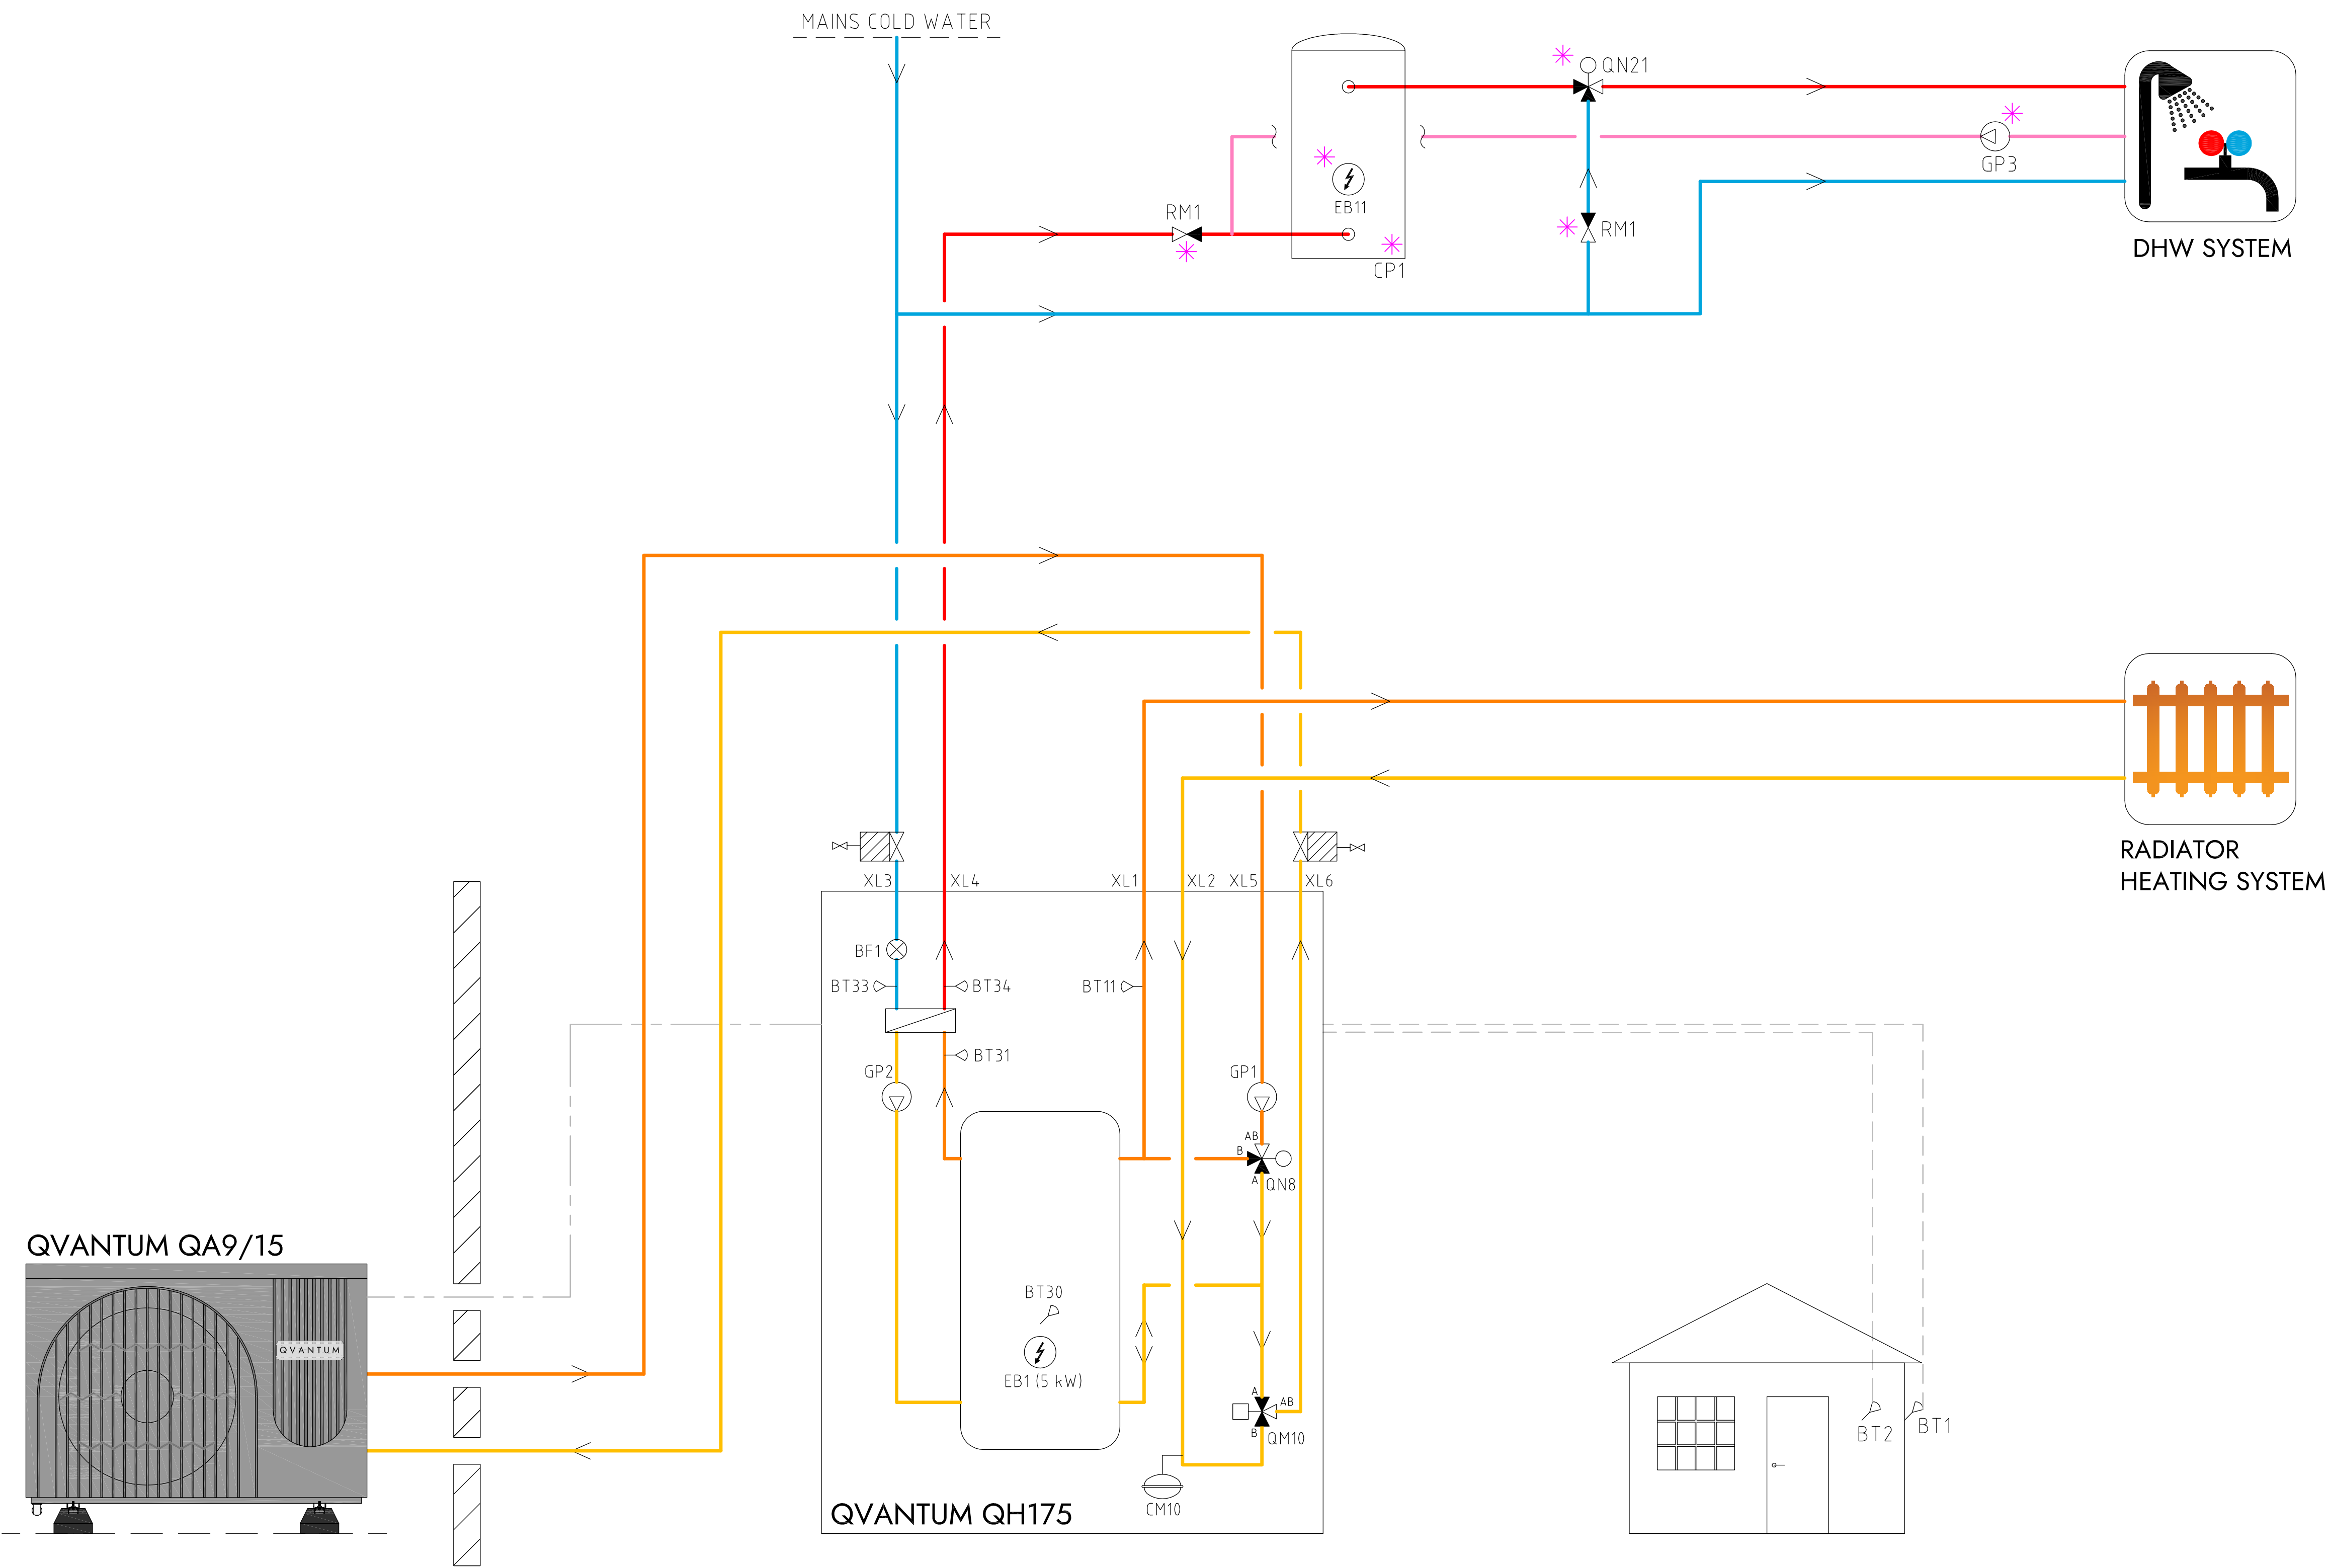

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
GP3	DHW circulation pump
CP1	DHW cylinder
EB11	Immersion heater
RM1	Non return valve hot water
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

RADIATOR HEATING SYSTEM

DHW SYSTEM

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-003	PAGE NUMBER 6
-----------------------	--	-------------------------

Information

QA9/15 & QH175, Underfloor heating
& hot water

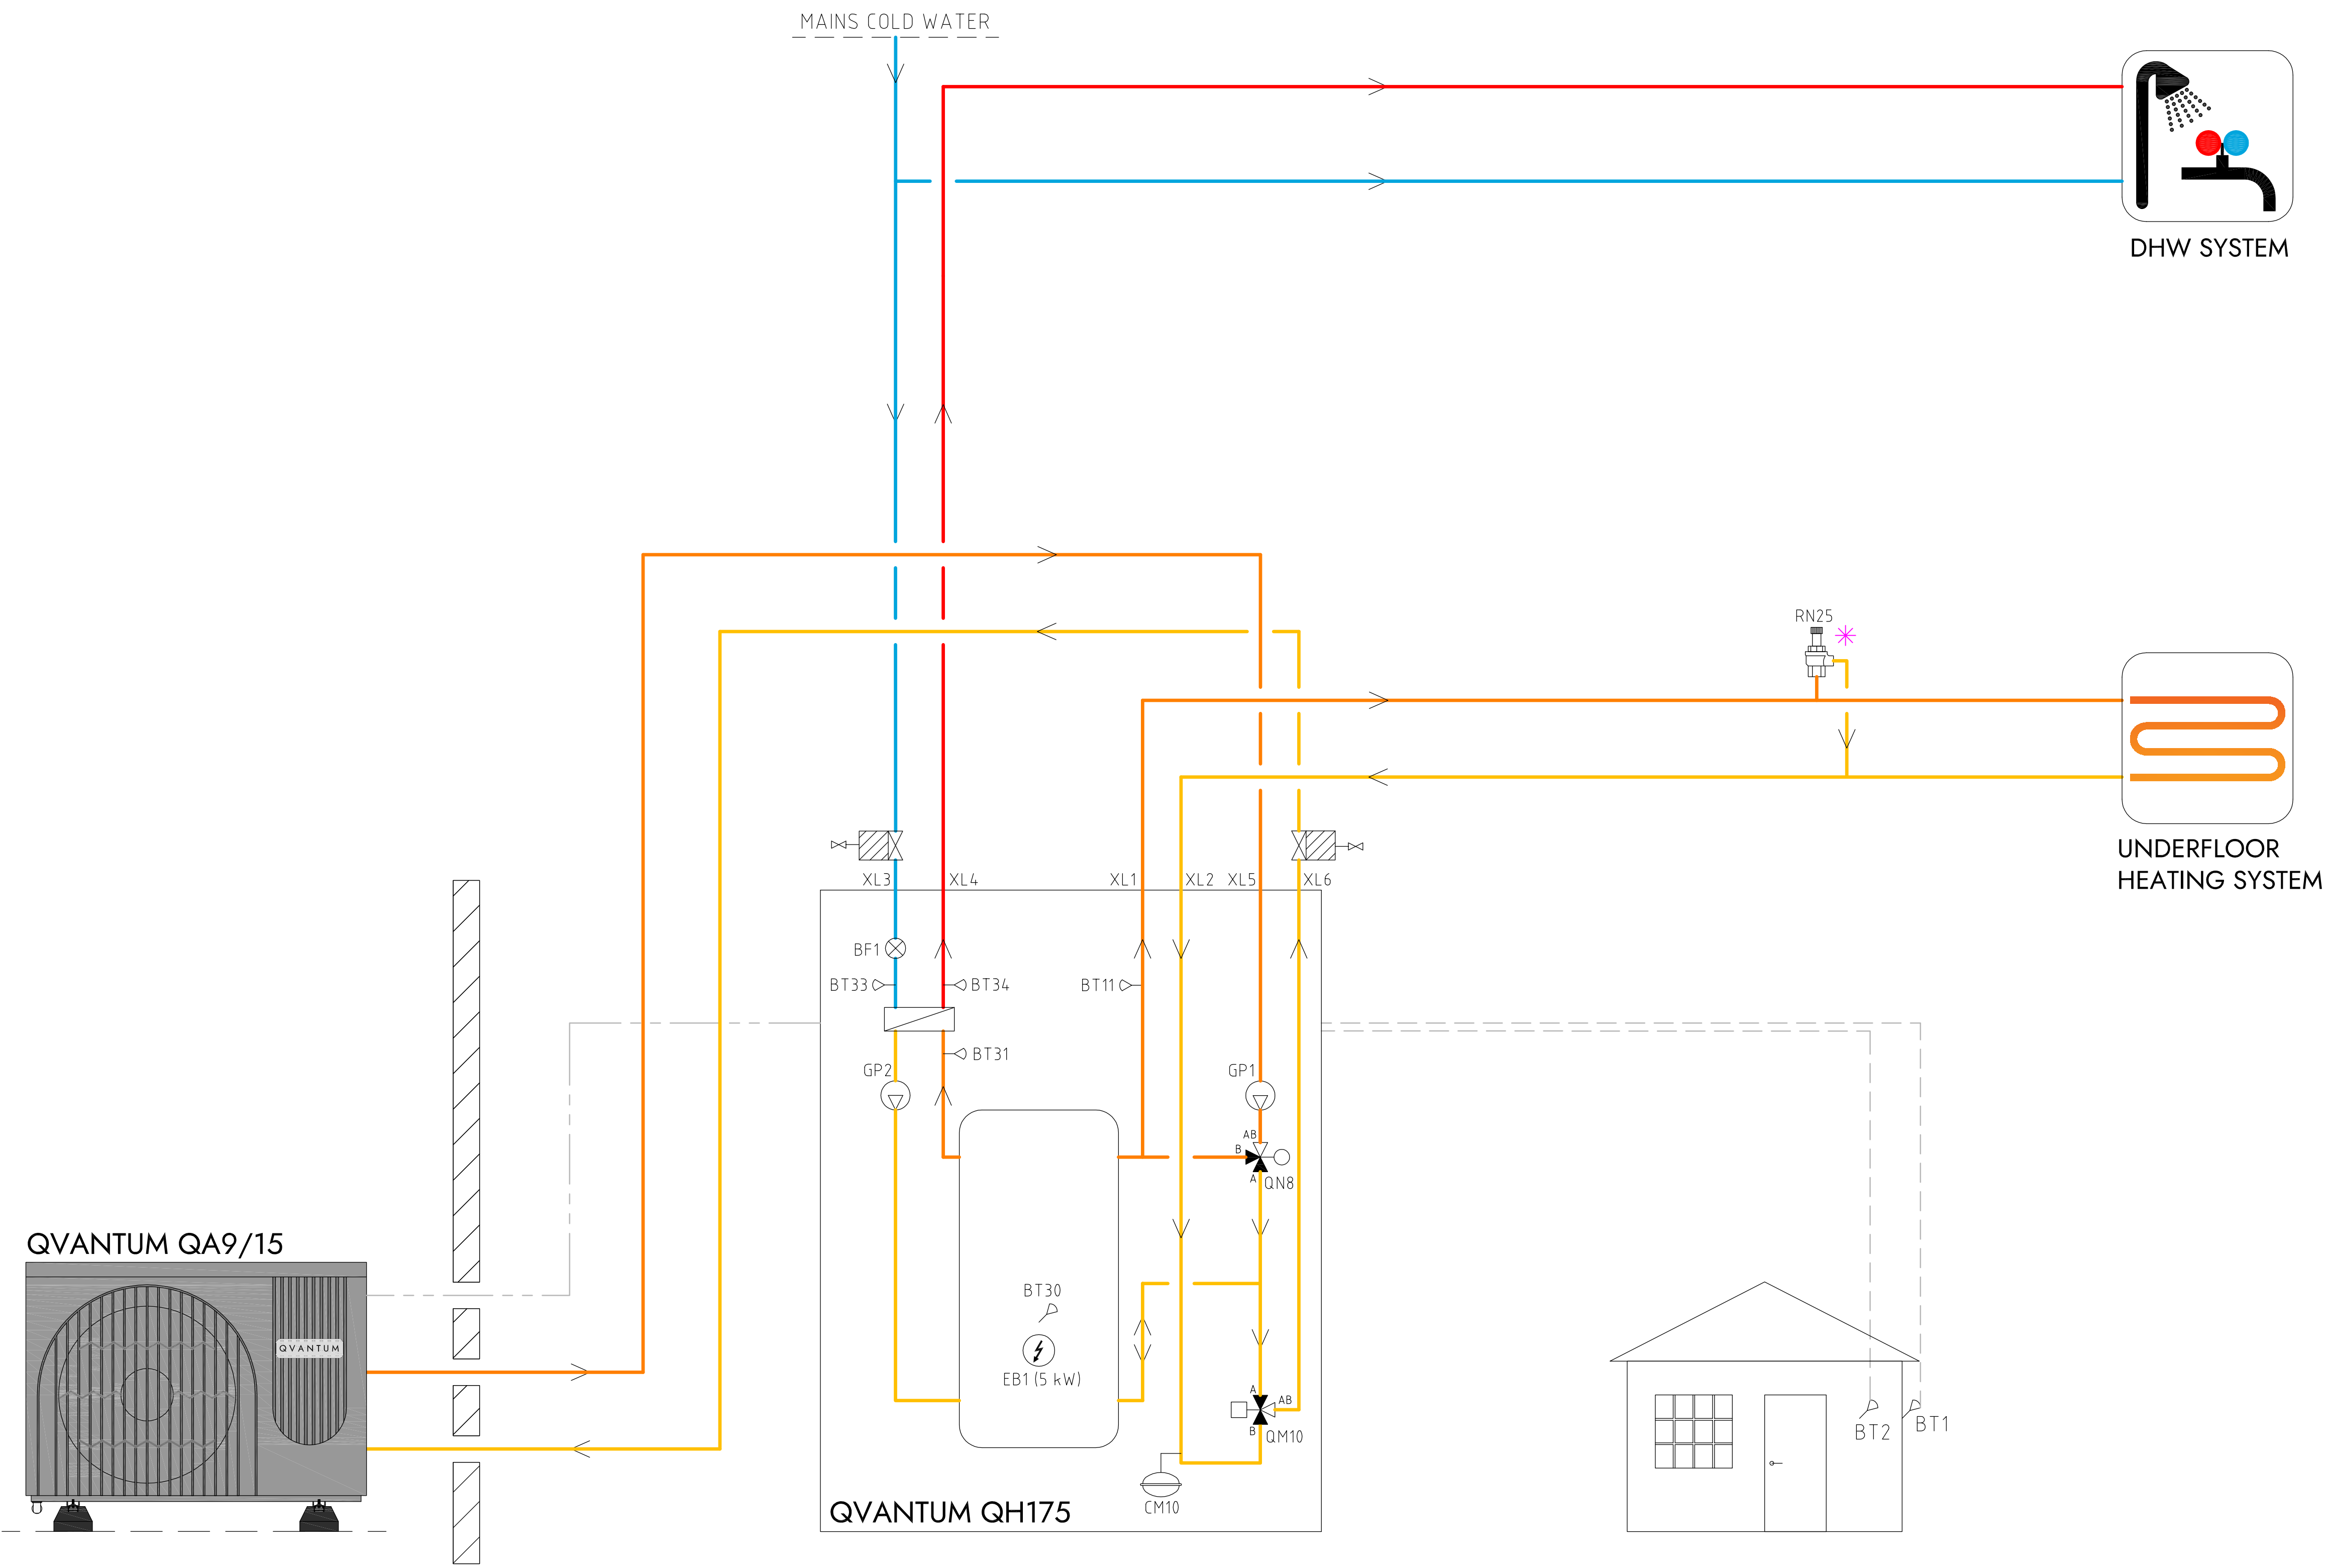

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

UNDERFLOOR
HEATING SYSTEM

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-004	PAGE NUMBER 7
-----------------------	--	-------------------------

Information

QA9/15 & QH175, Underfloor heating
& hot water with external hot water tank

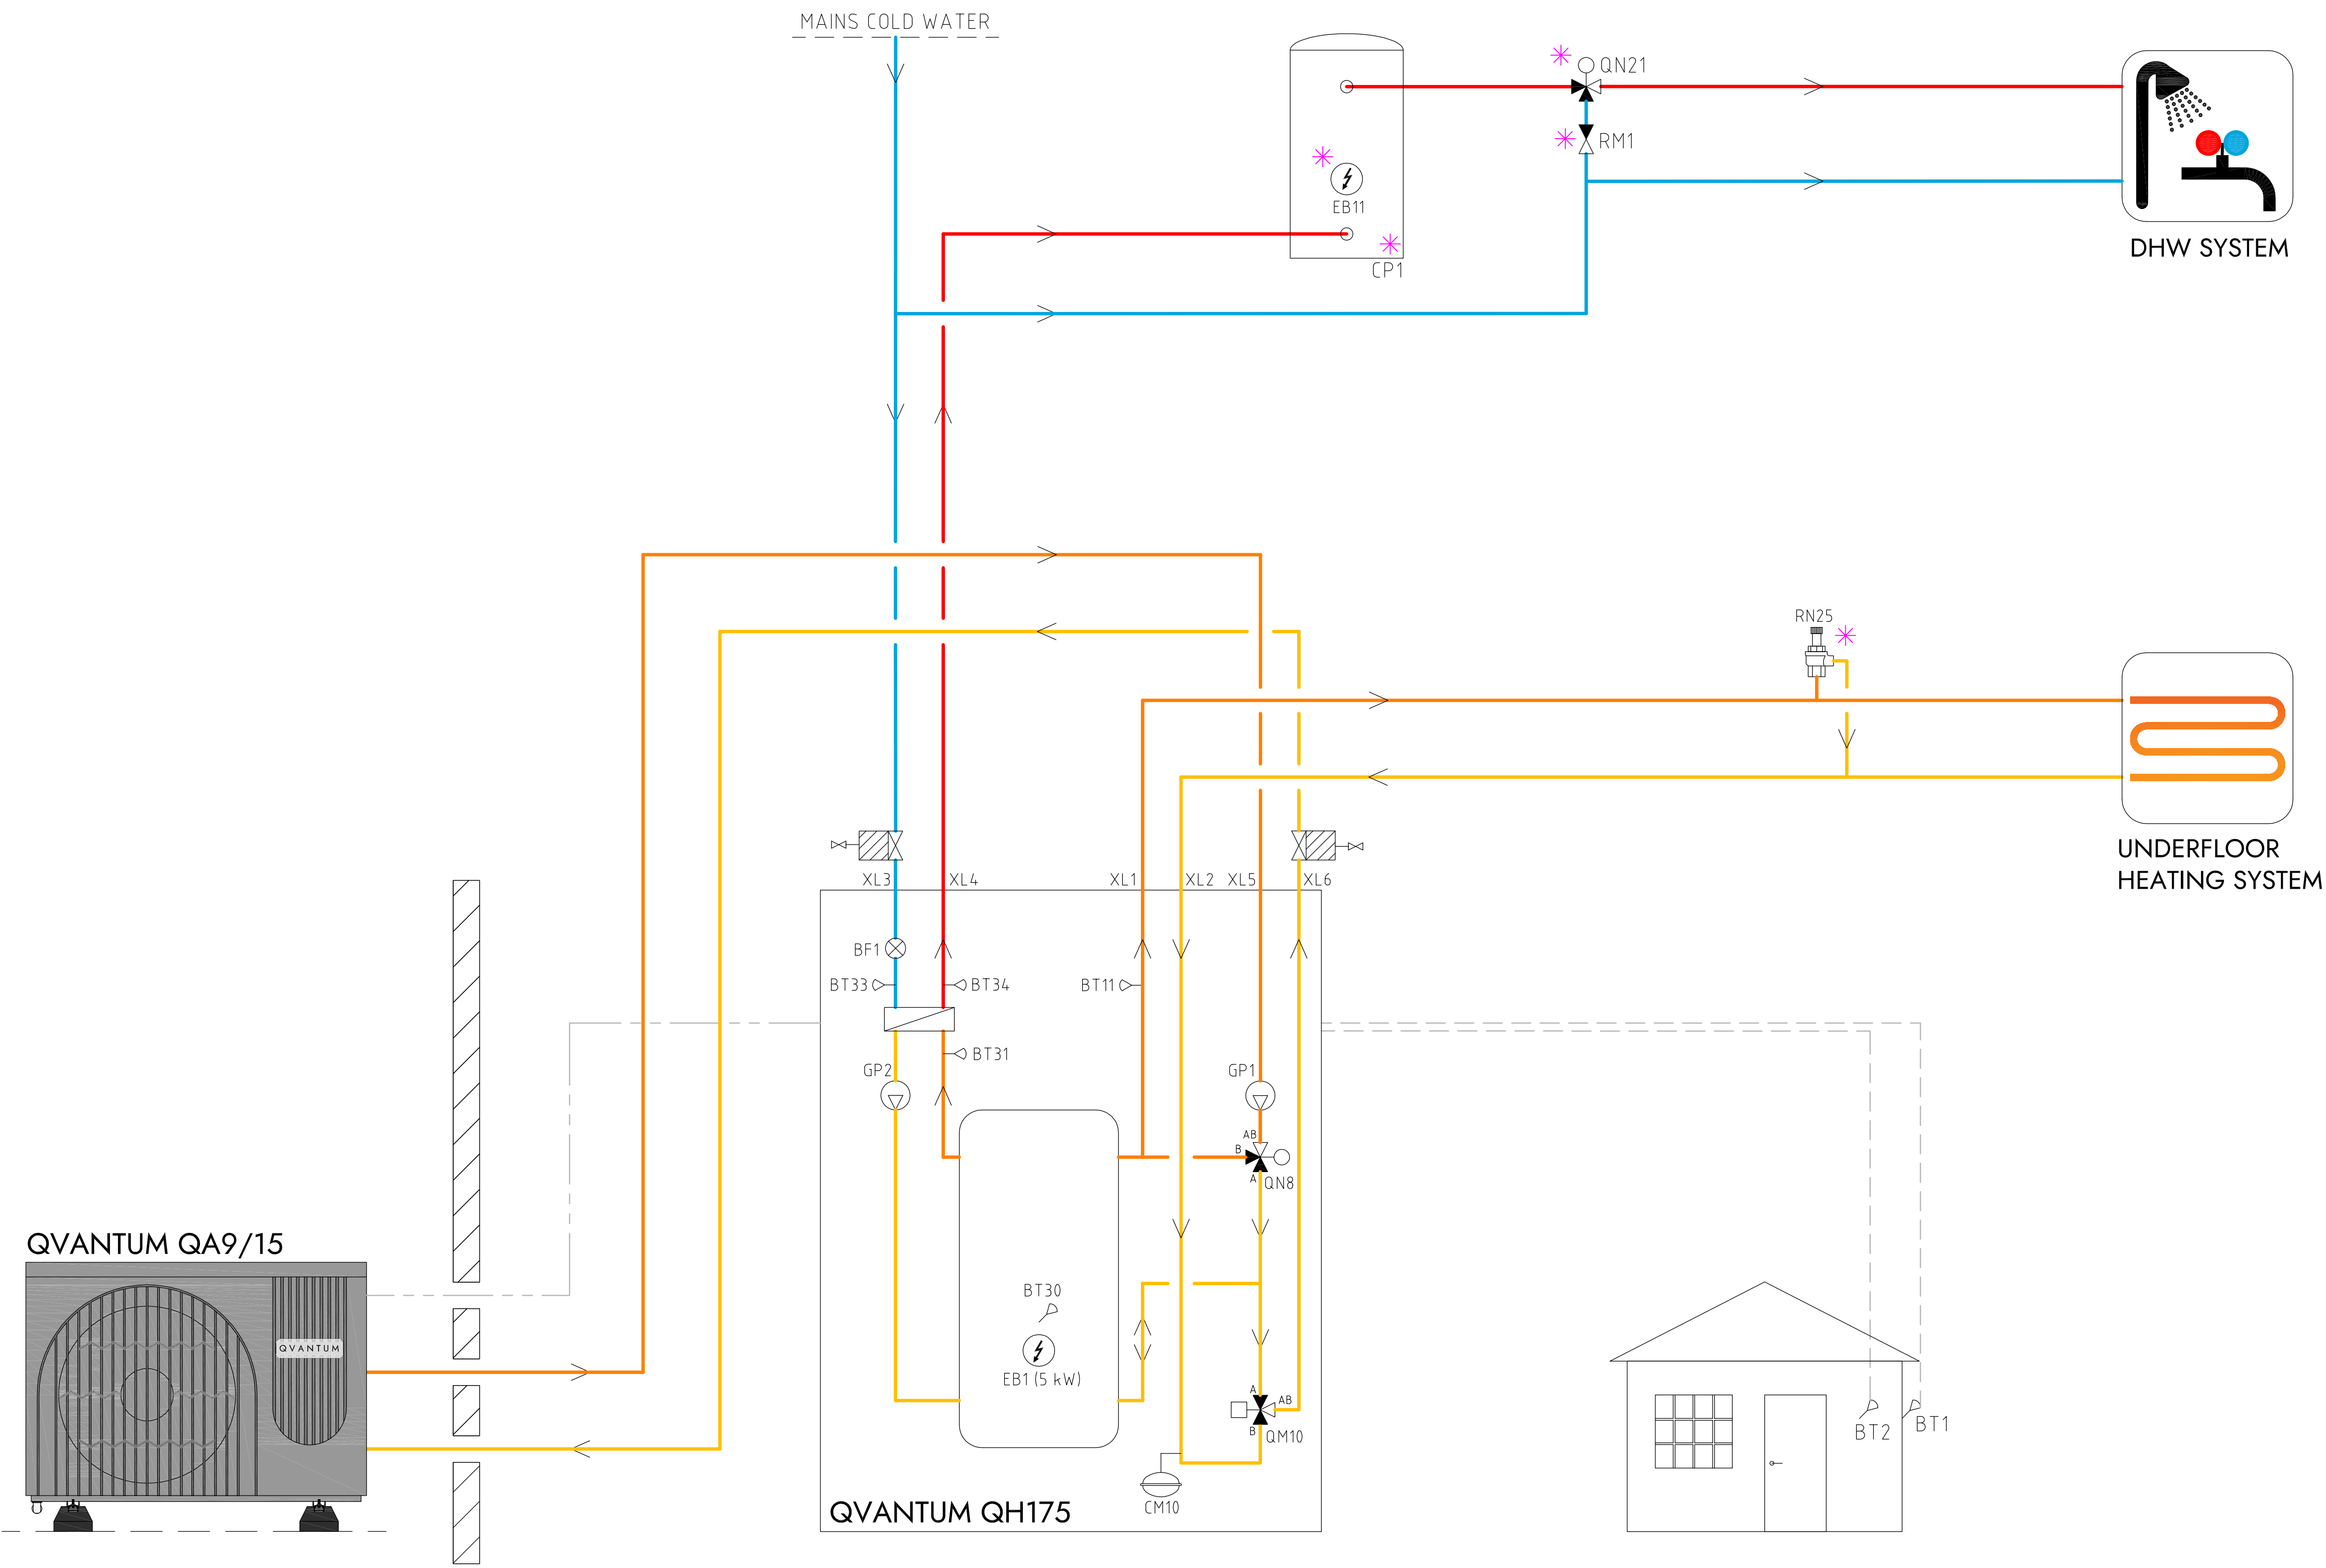


COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
CP1	DHW cylinder
EB11	Immersion heater
RN25	Overflow valve
*	Components not delivered by Qvantum


COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

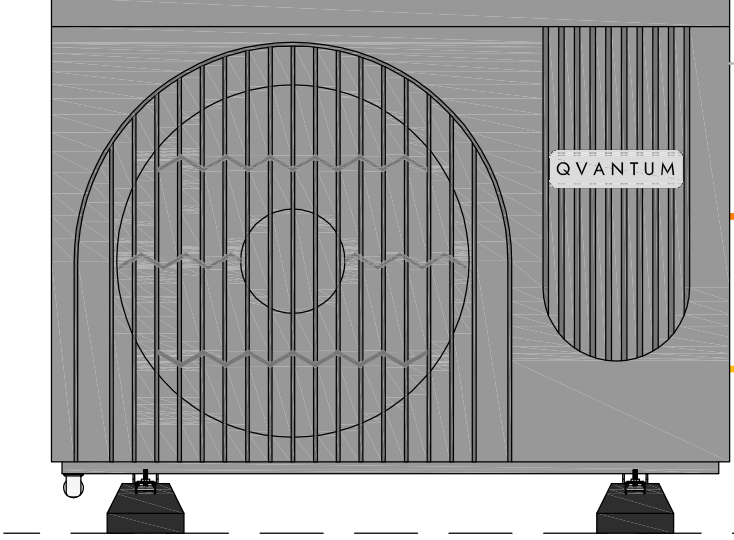

QVANTUM QH175

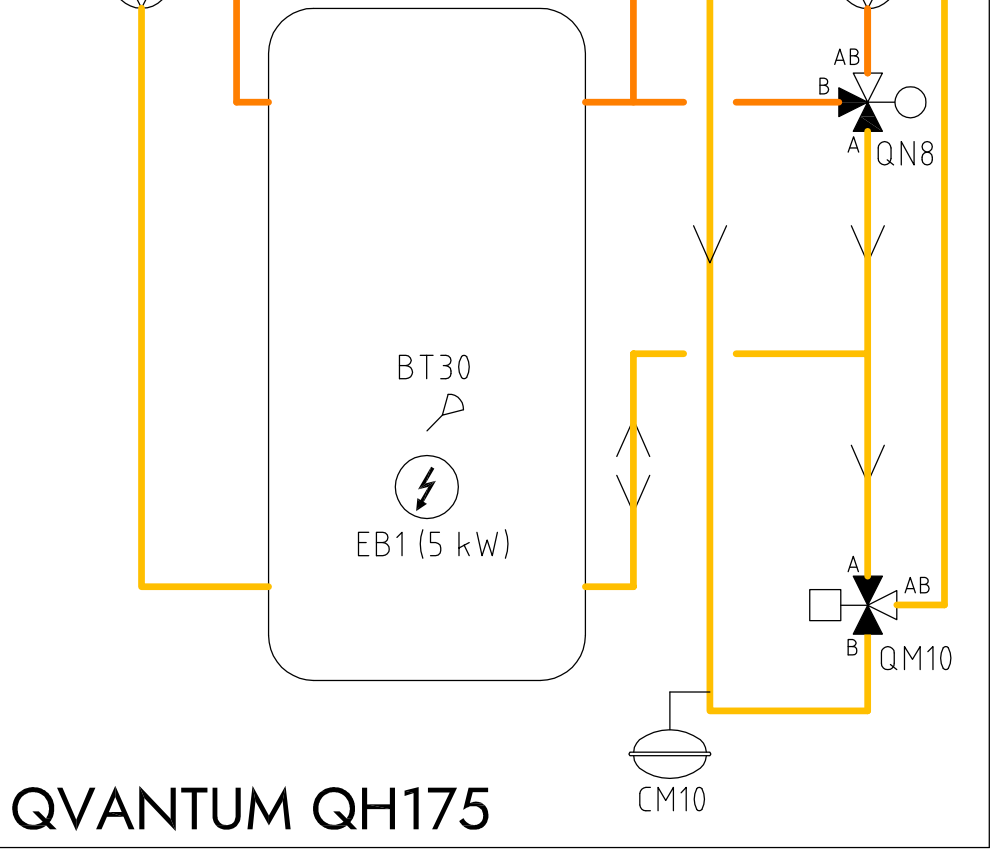

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-005	PAGE NUMBER 8
-----------------------	--	-------------------------

Information

QA9/15 & QH175, Underfloor heating
& hot water with external hot water tank
& hot water circulation

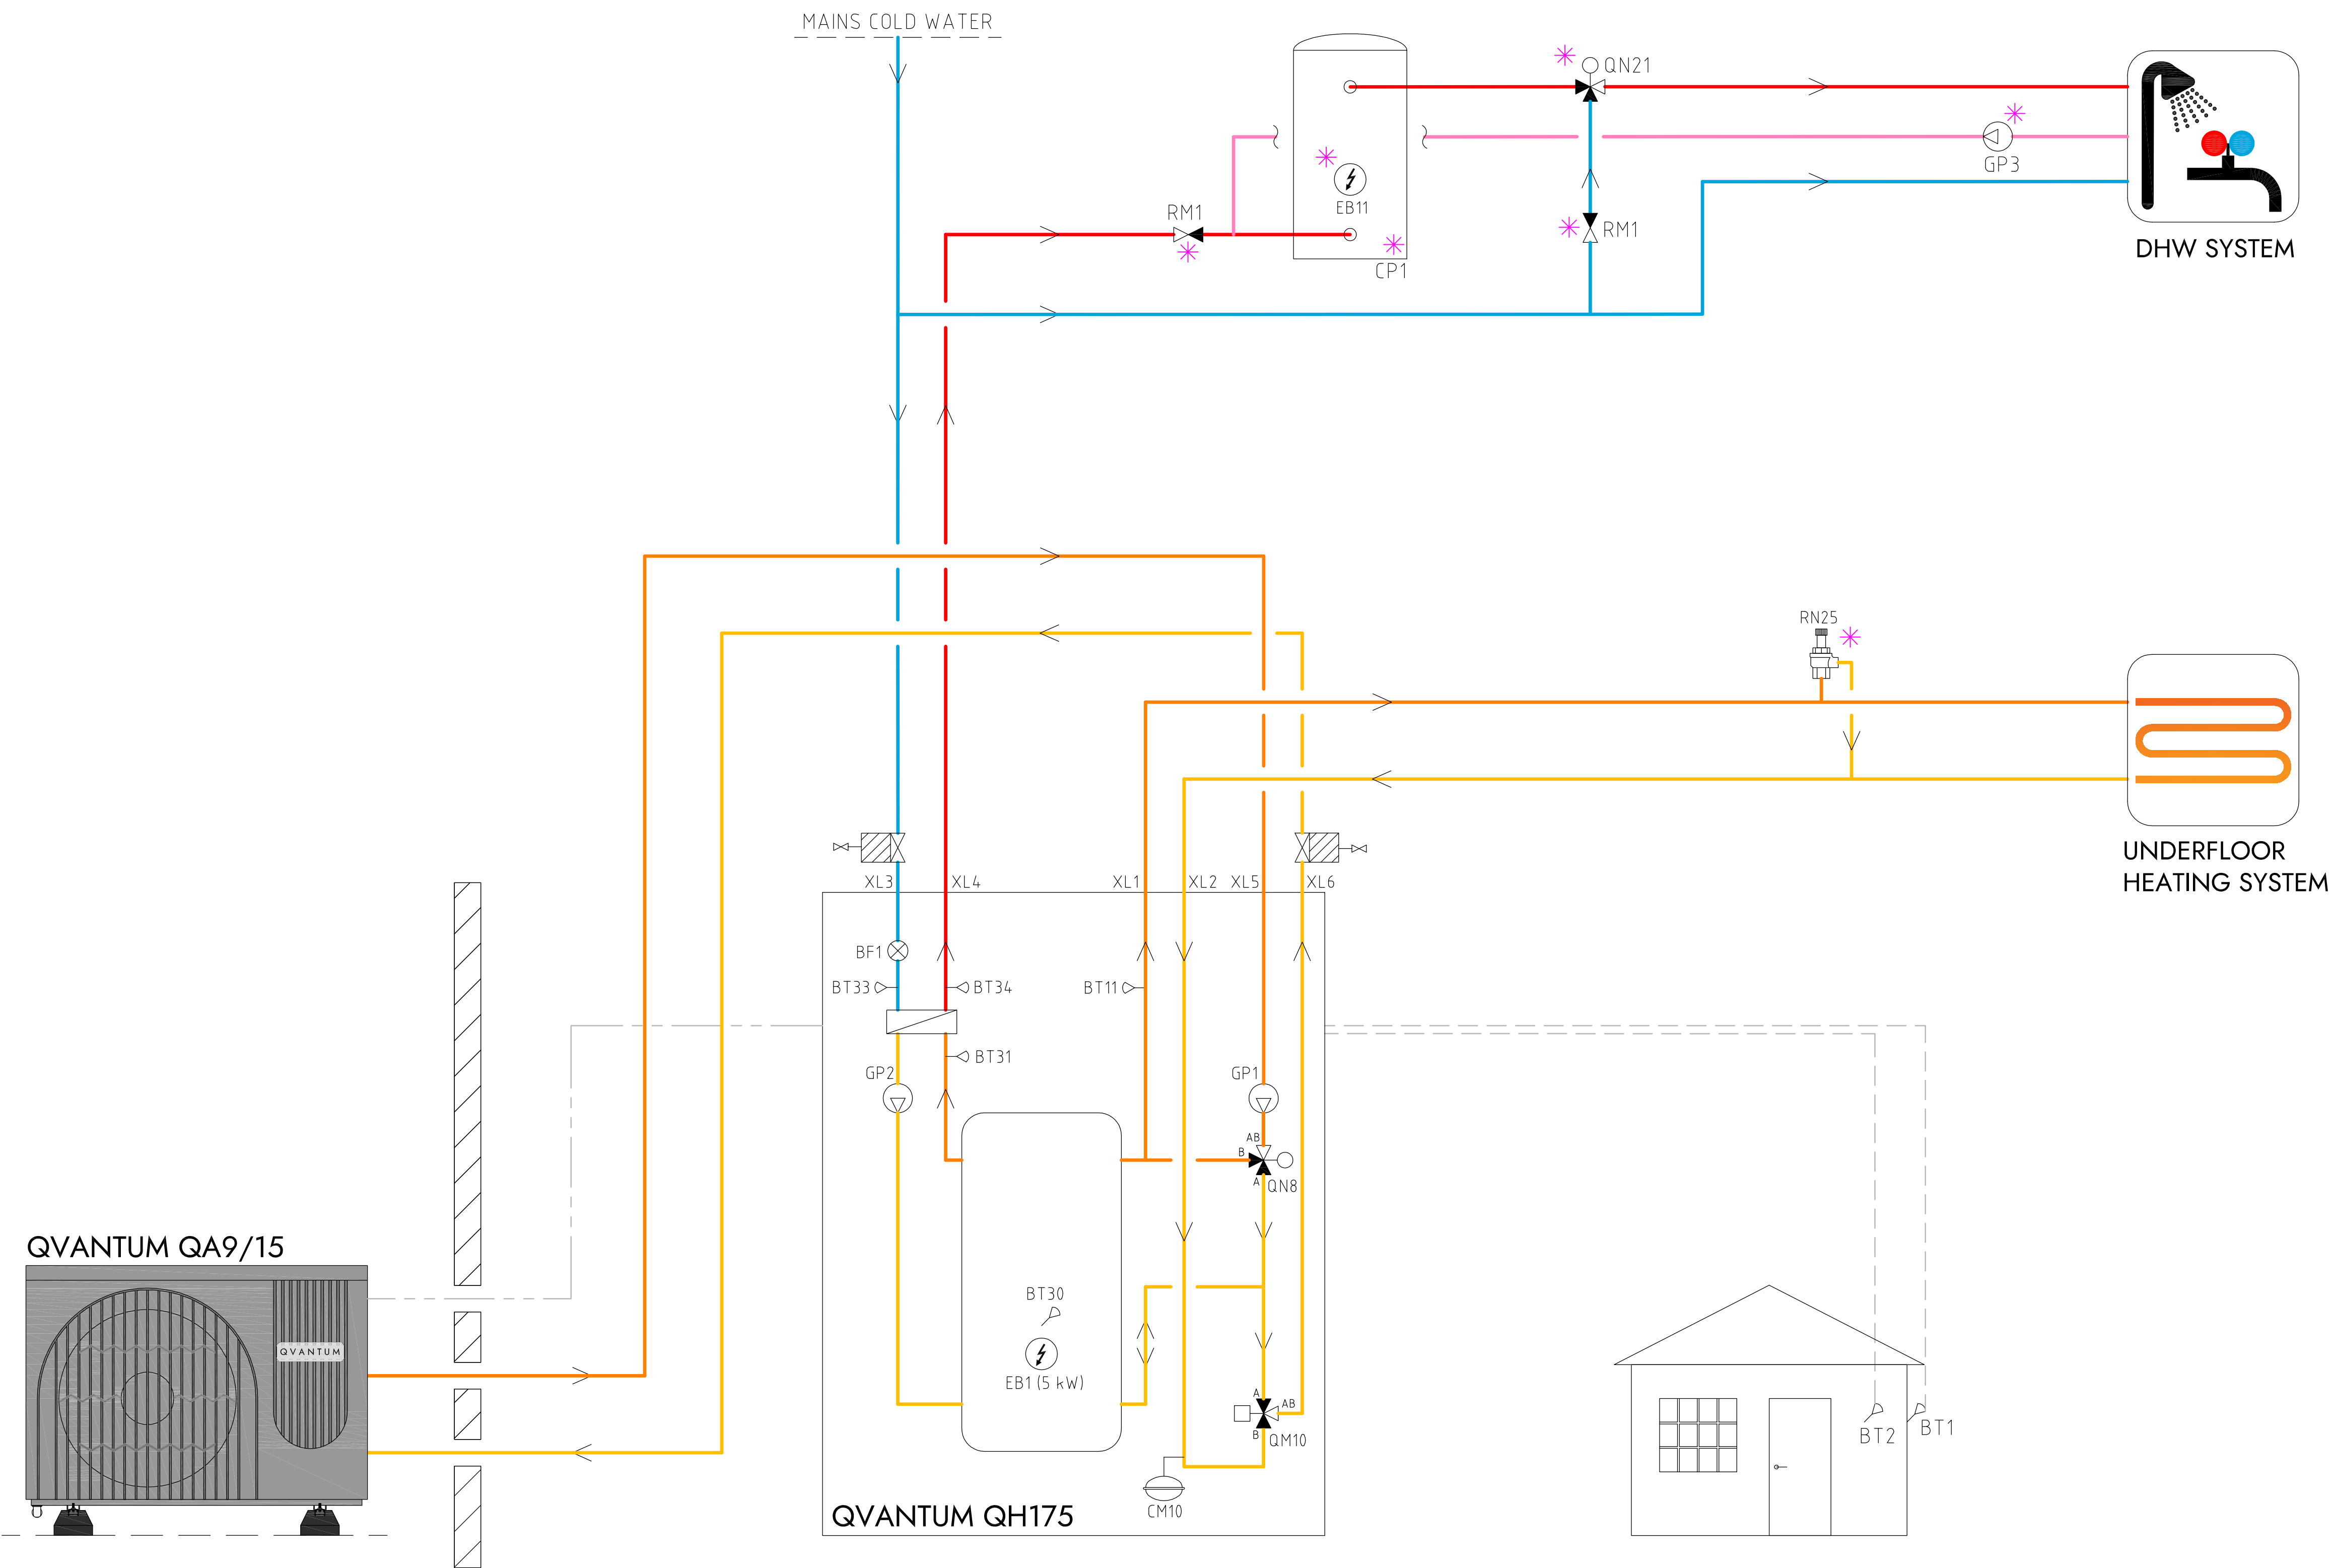

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
GP3	DHW circulation pump
CP1	DHW cylinder
EB11	Immersion heater
RM1	Non return valve hot water
RN25	Overflow valve
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-006	PAGE NUMBER 9
-----------------------	--	-------------------------

Information

QA9/15 & QH175, heating & hot water, second heating system

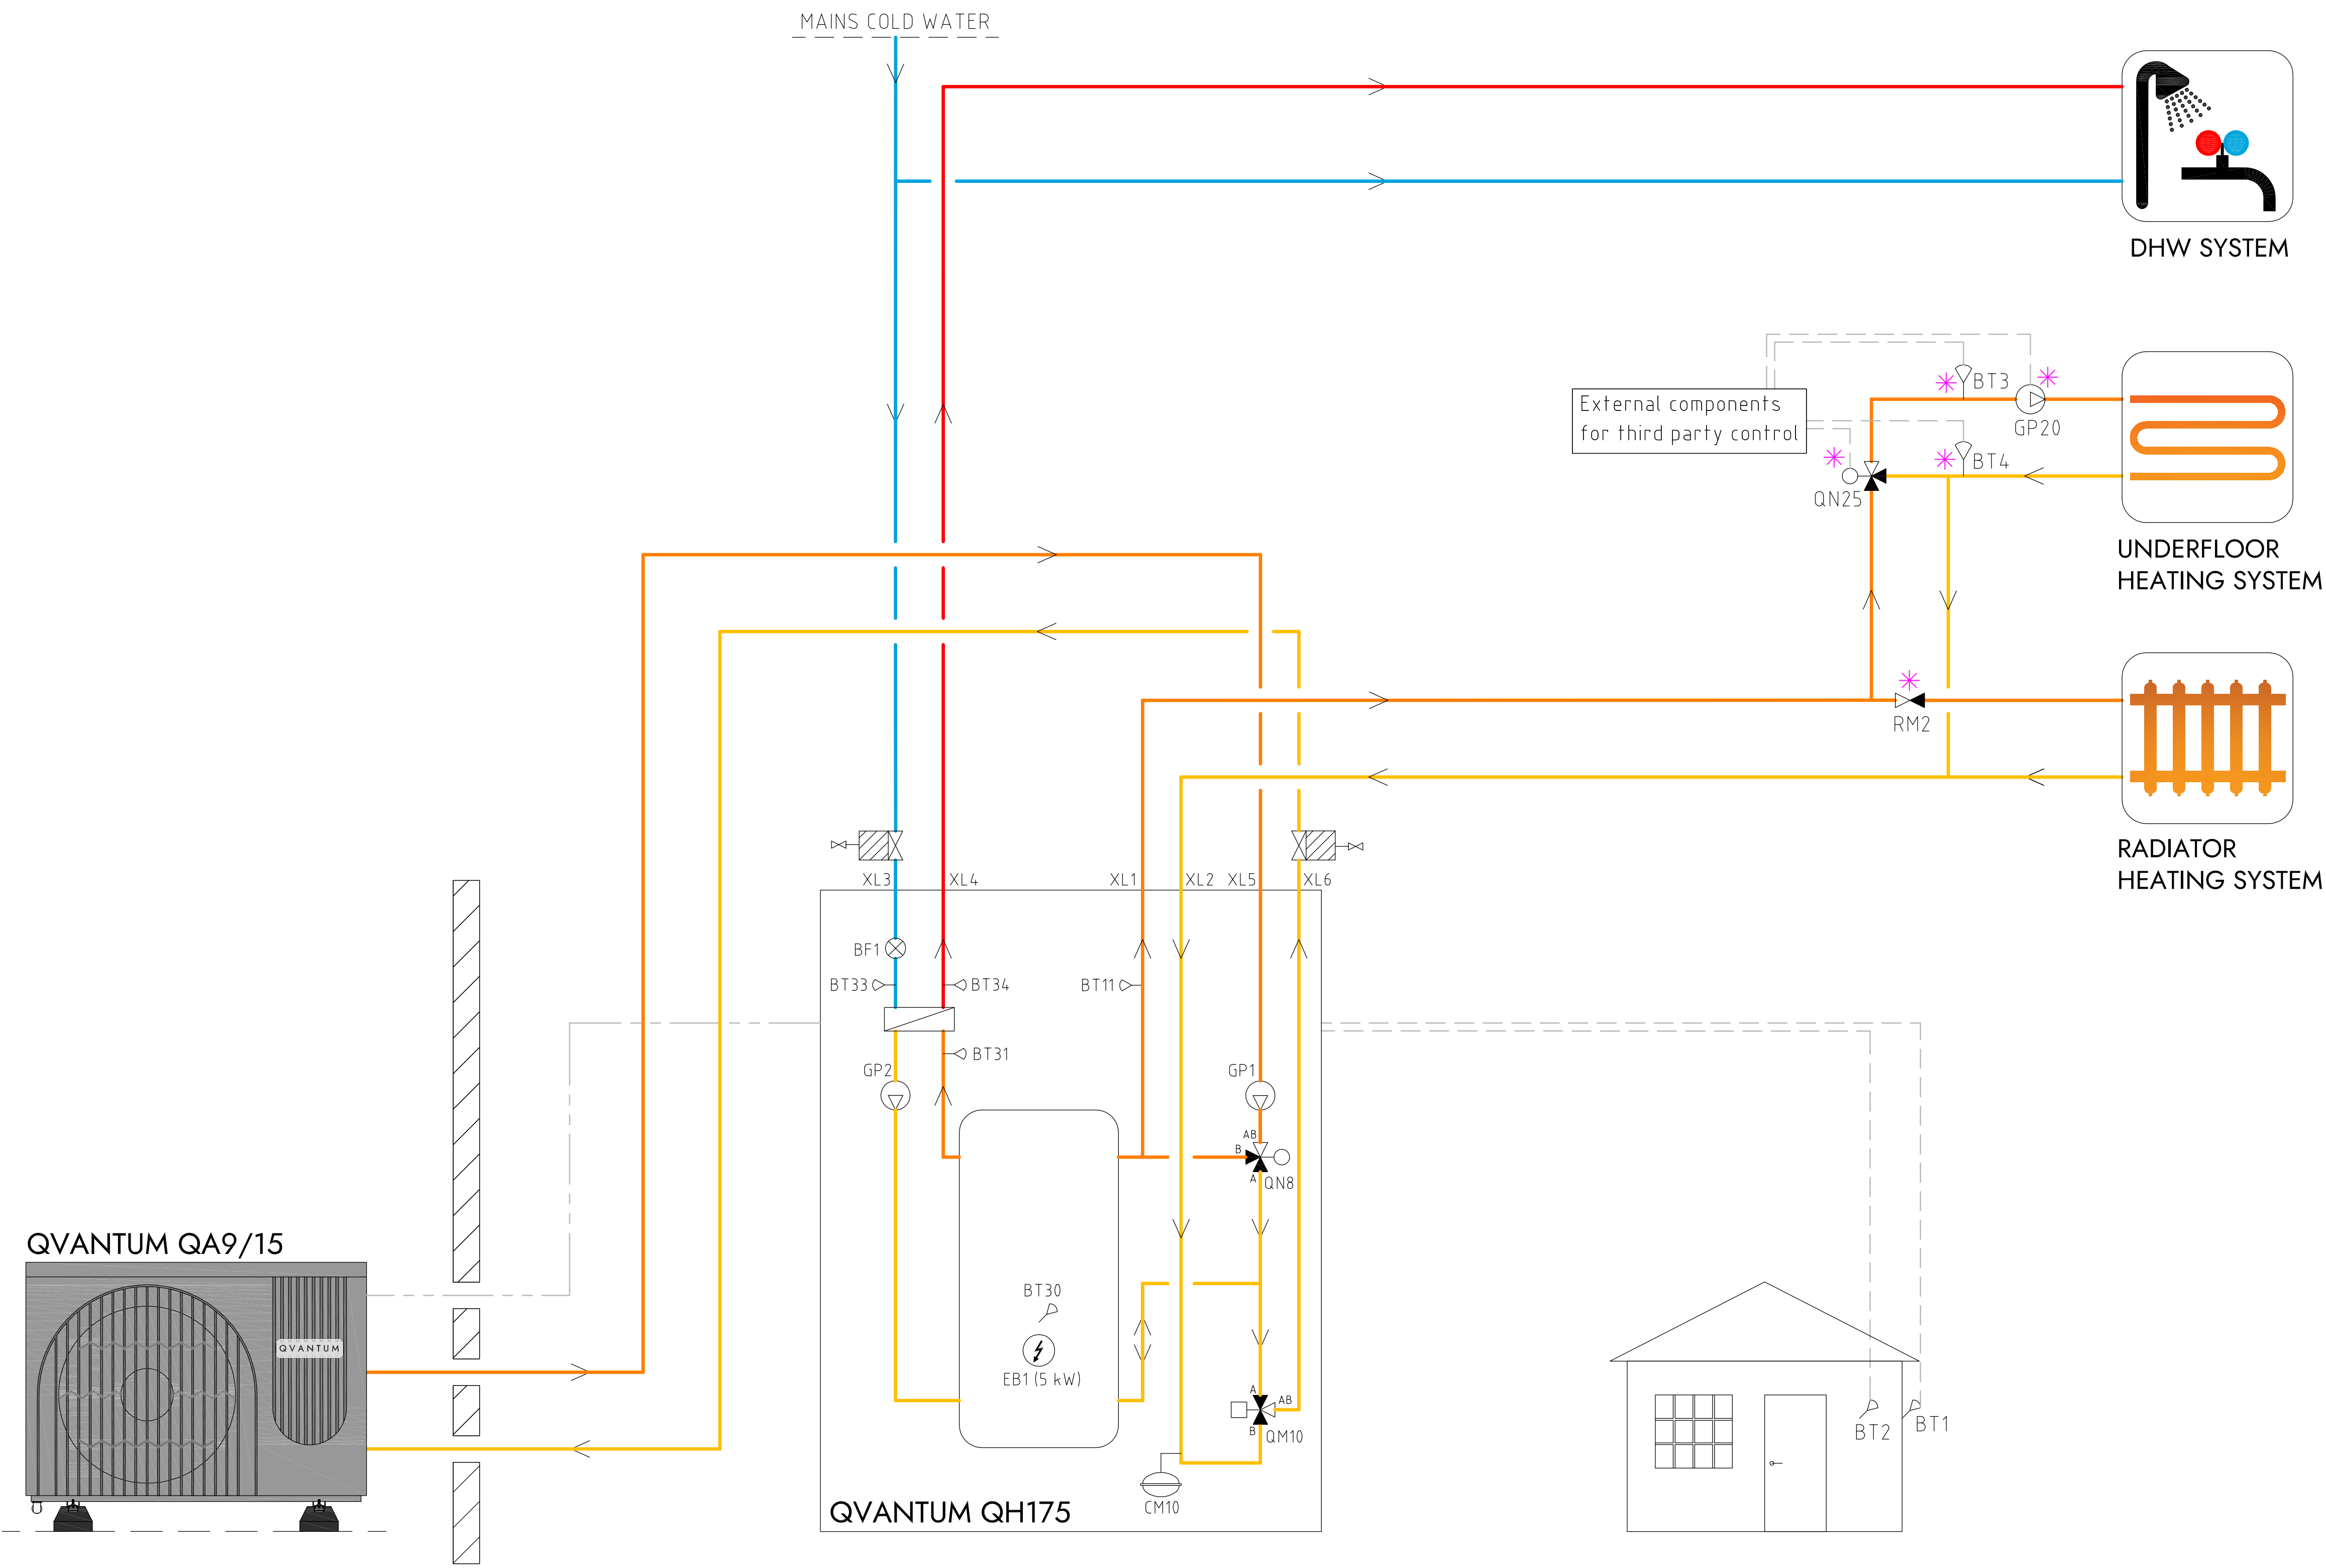

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
RM2	Non return valve heat system
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.


Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-007	PAGE NUMBER 10
----------------	-----------------------------------	-------------------

Information

QA9/15 & QH175, heating & hot water with external hot water tank, second heating system

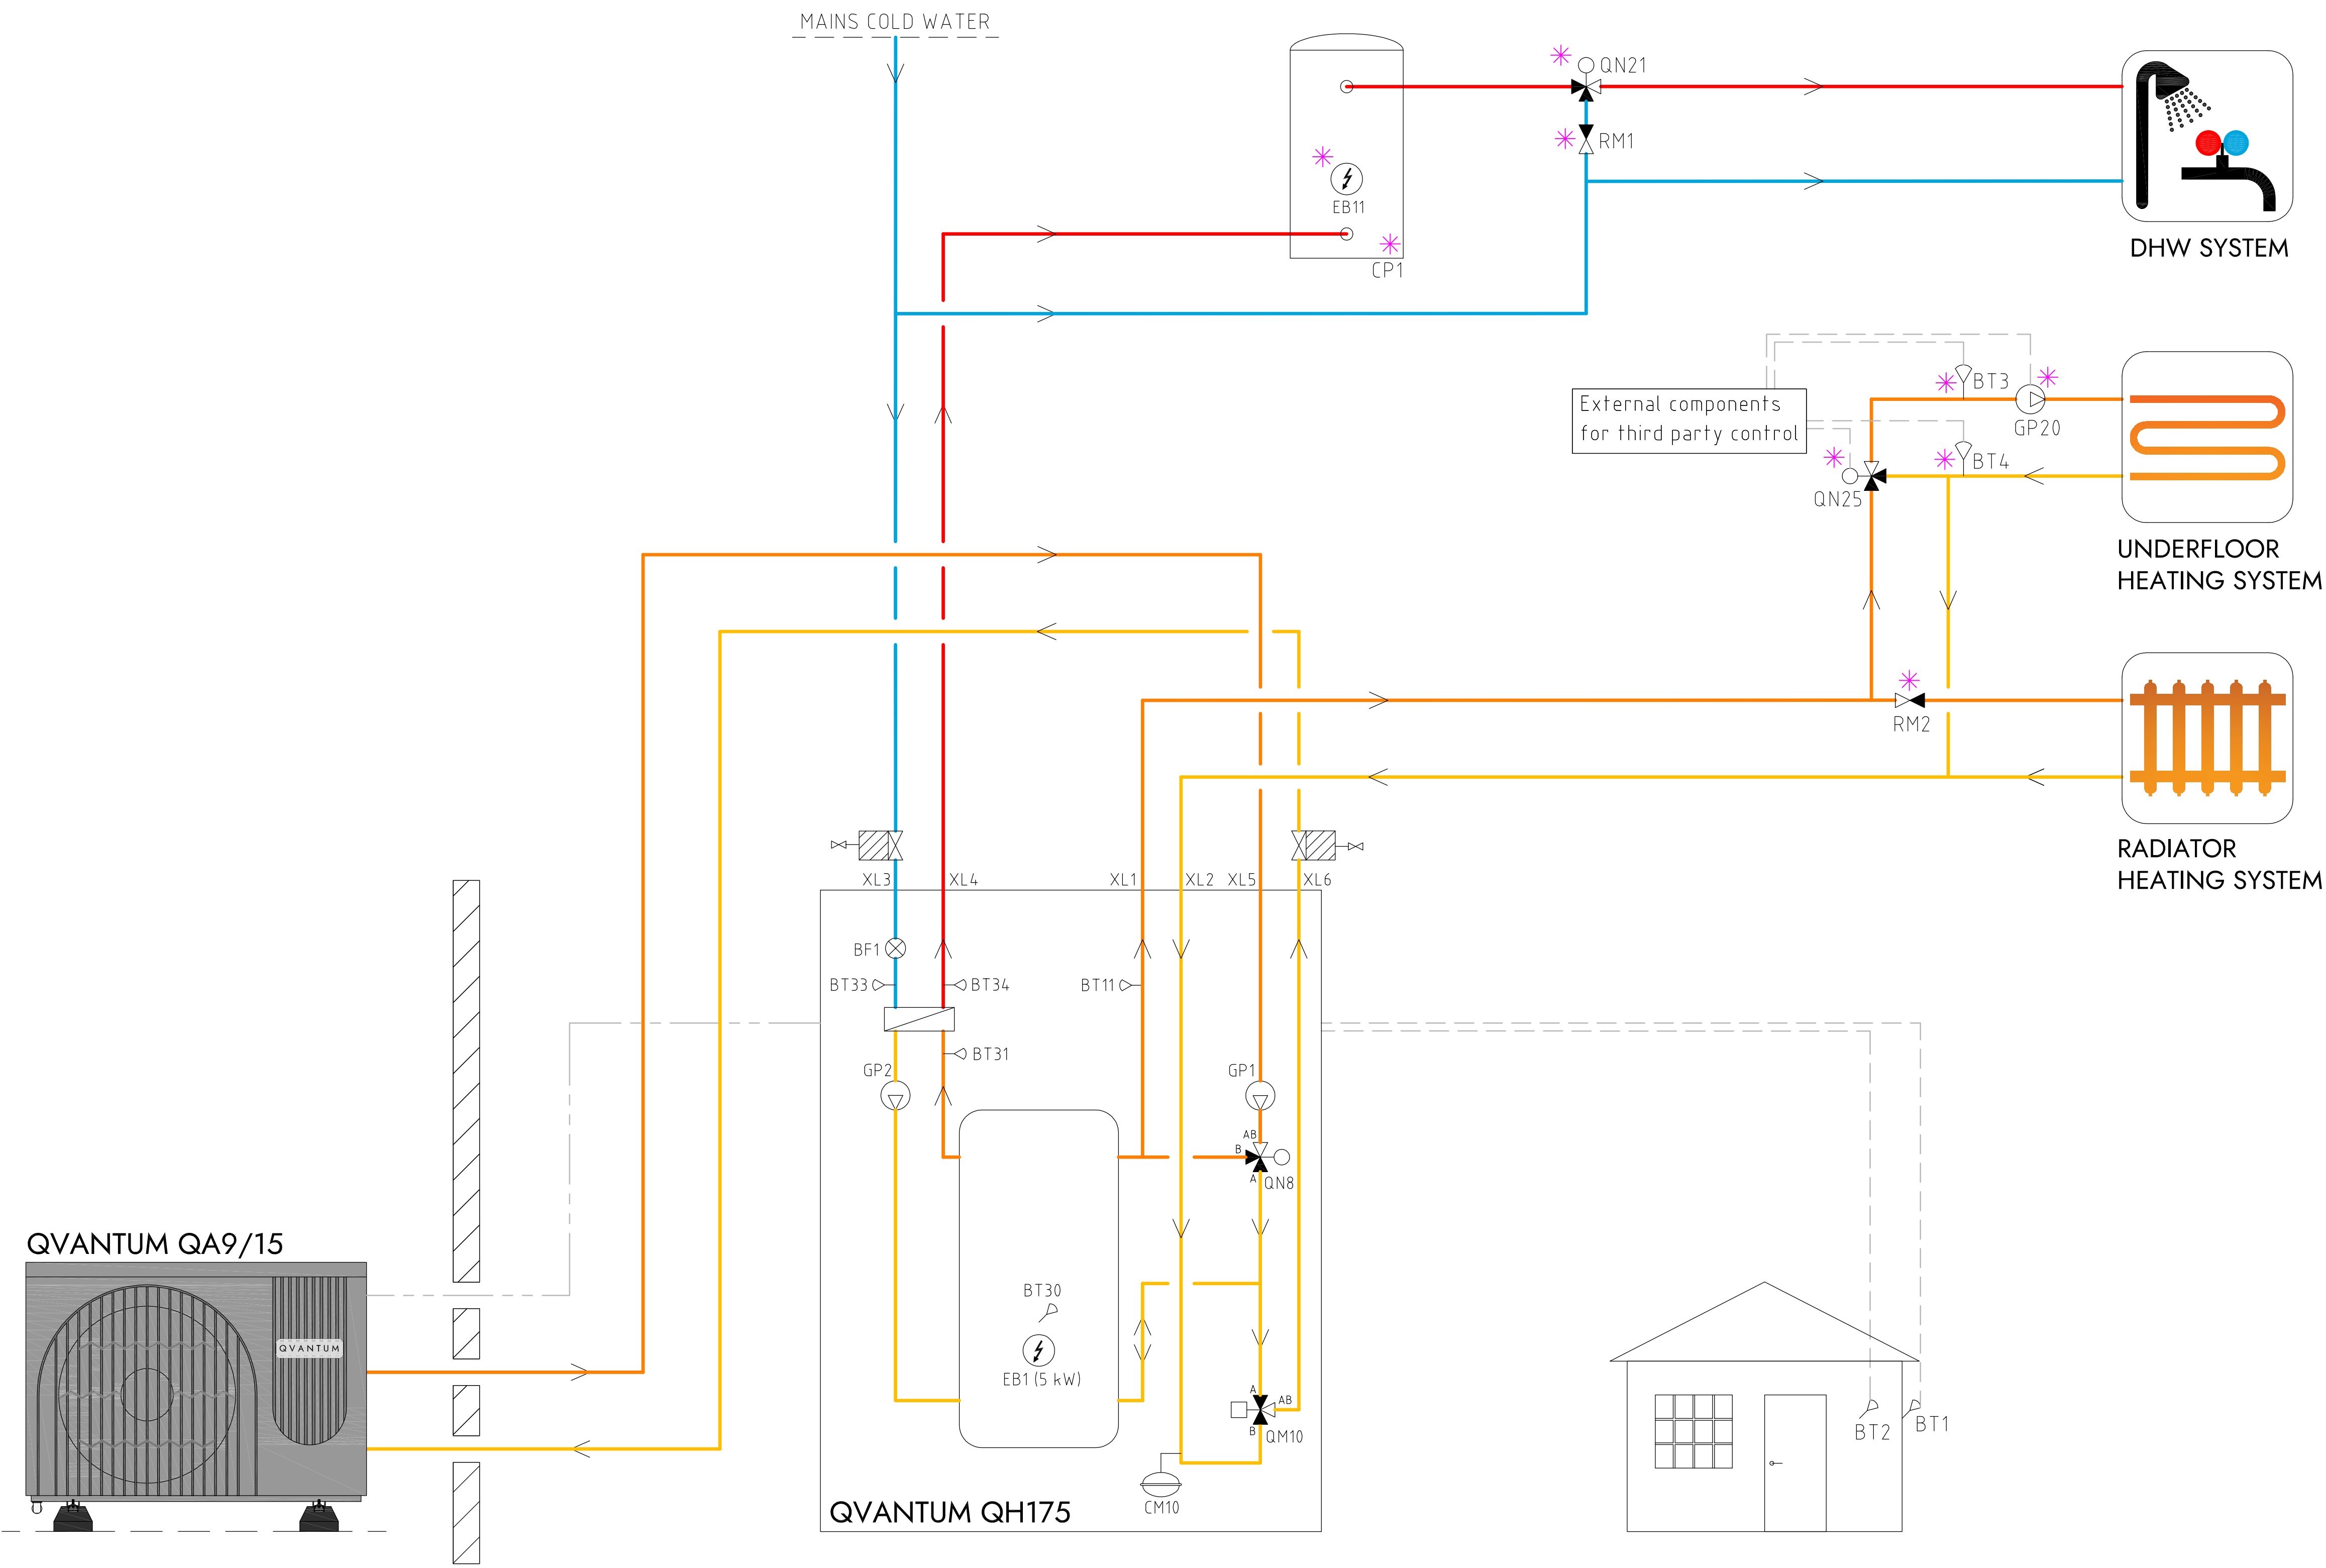


COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
CP1	DHW cylinder
EB11	Immersion heater
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
RM2	Non return valve heat system
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

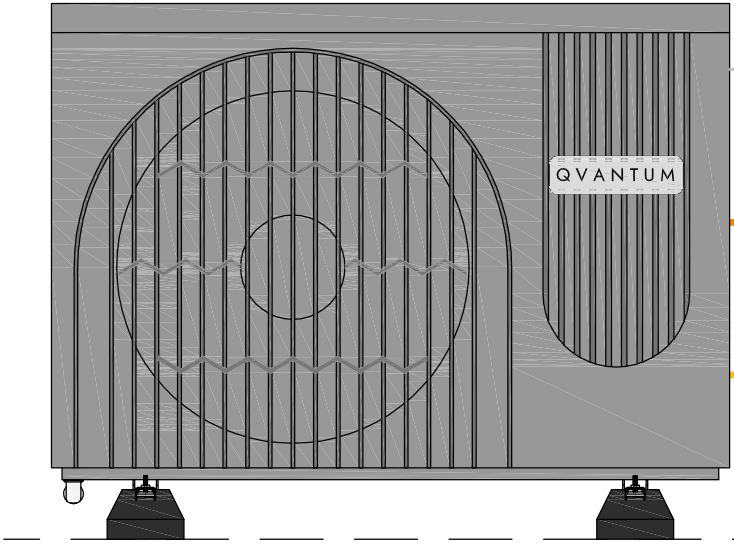

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.

Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp


DRAWN BY
JE

DRAWING NUMBER
QA9:15-56-8-008

PAGE NUMBER
11

Information

QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, second heating system

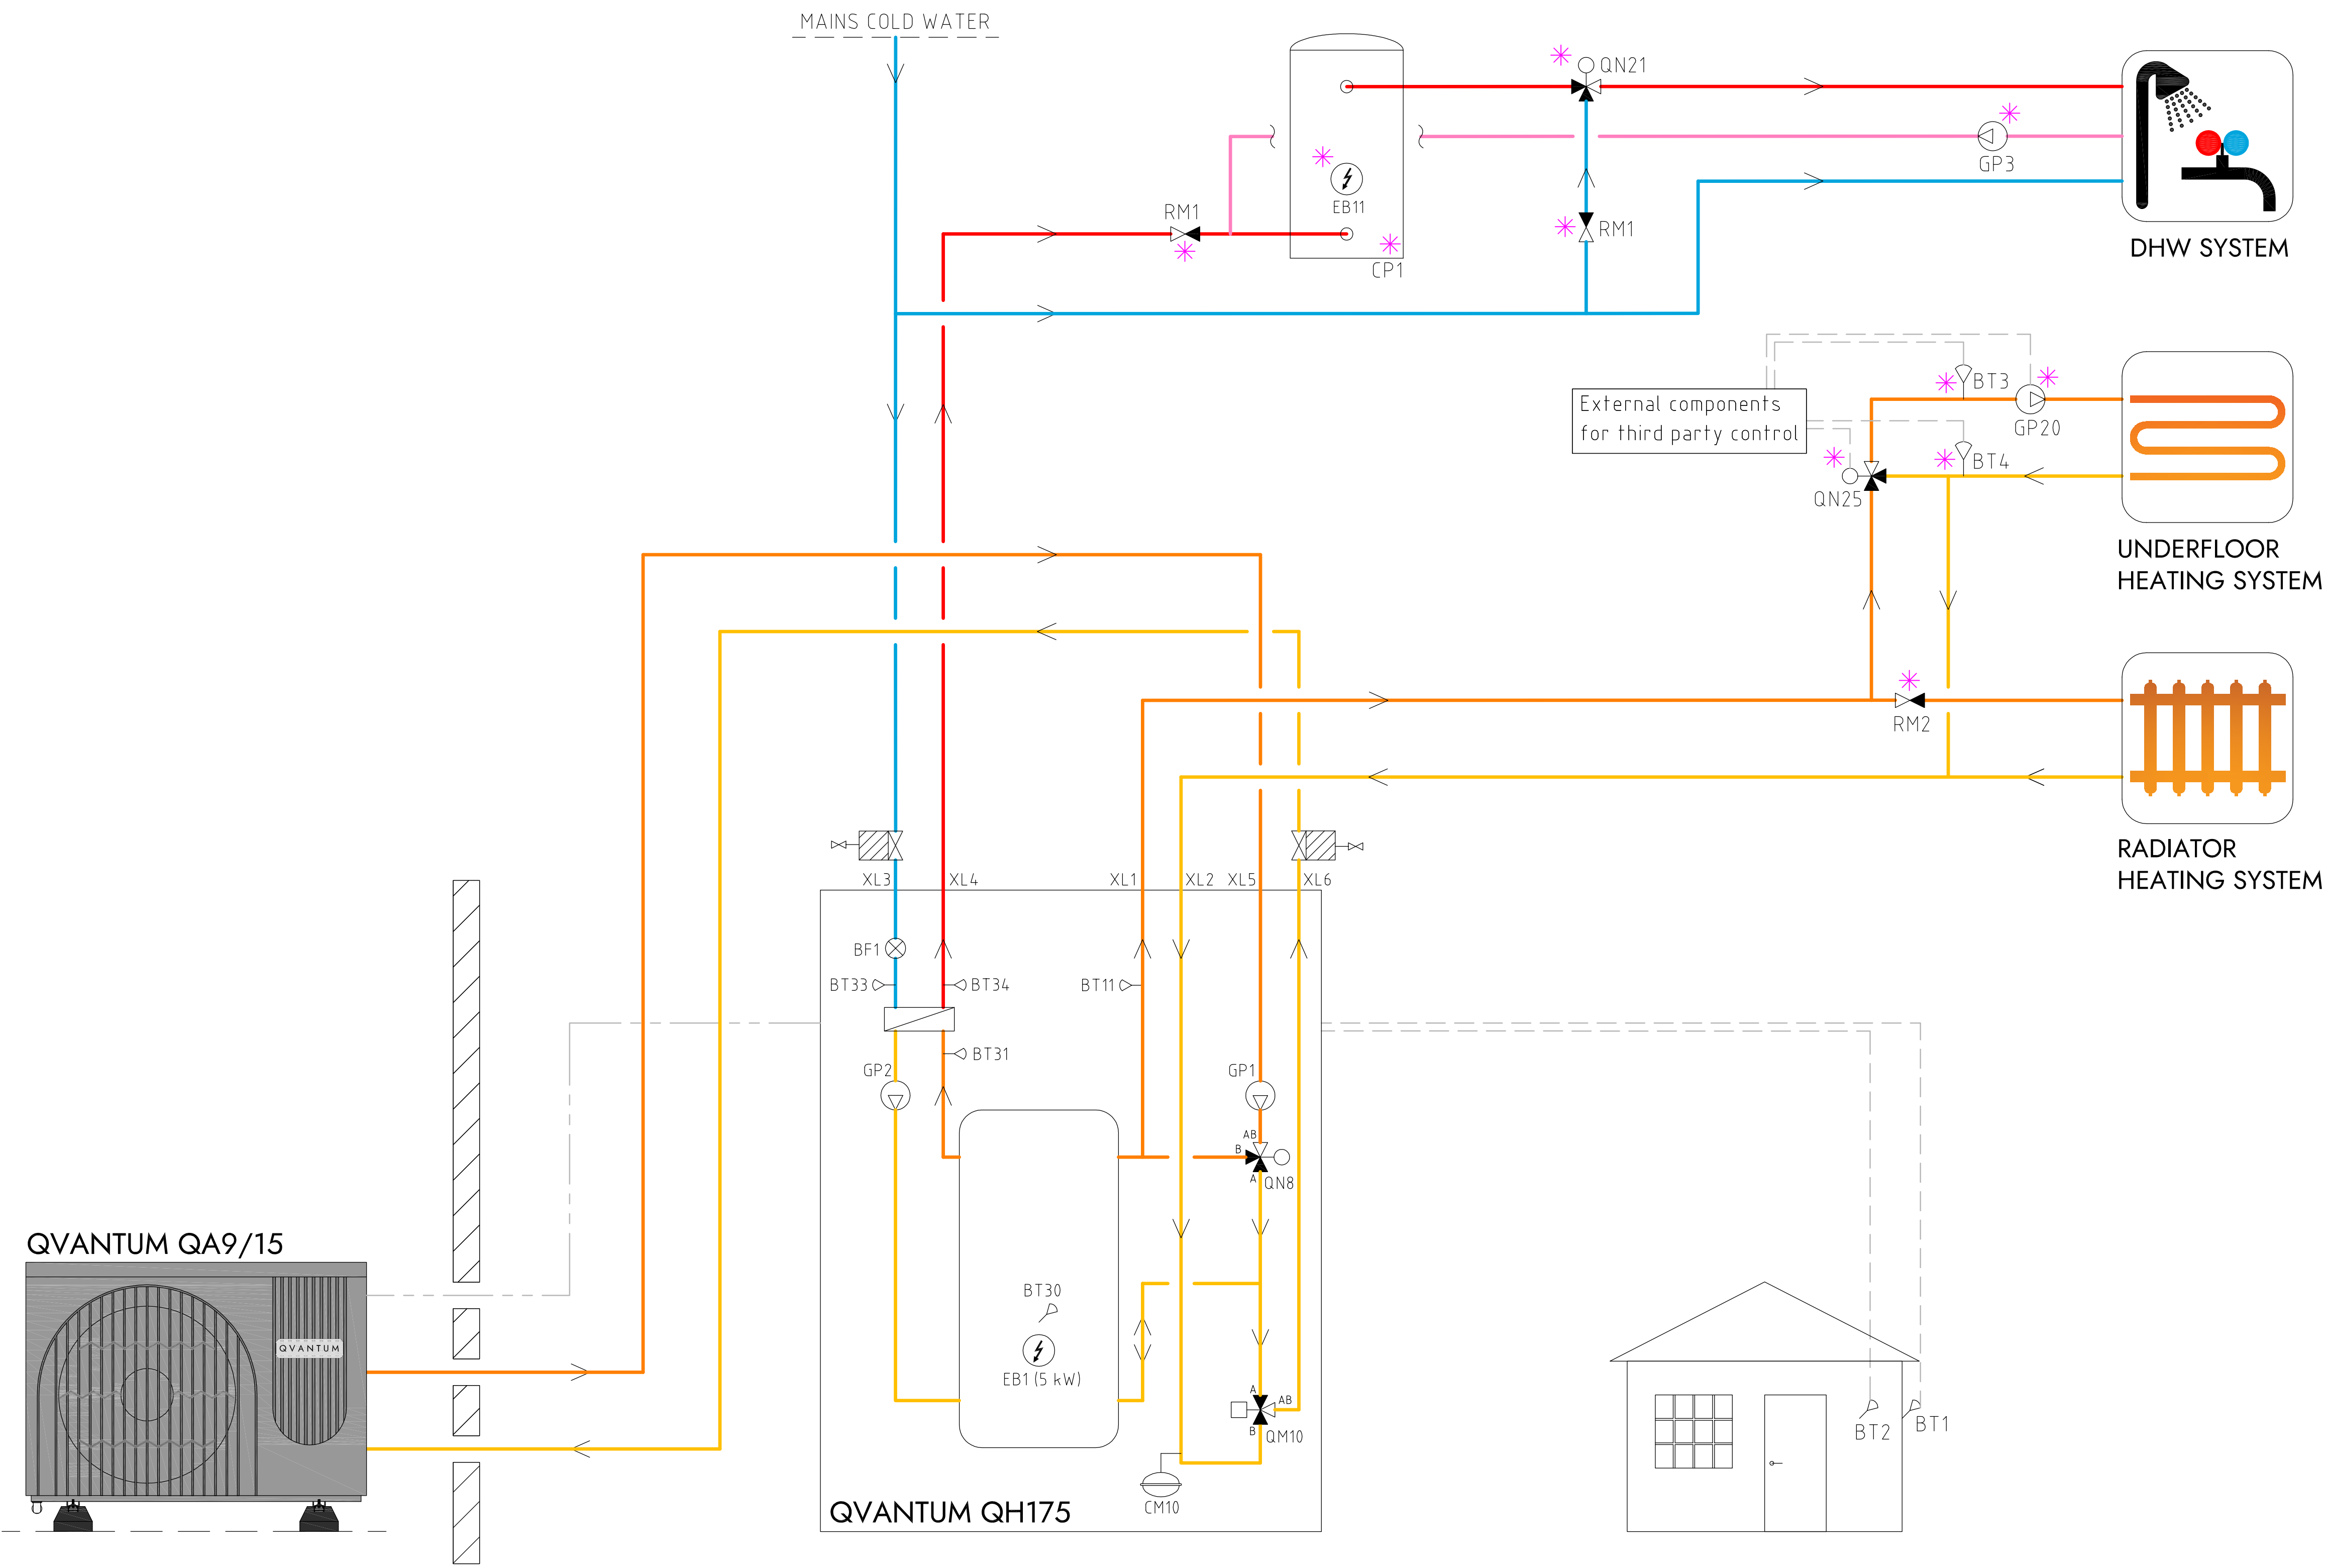


COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
GP3	DHW circulation pump
CP1	DHW cylinder
EB11	Immersion heater
RM1	Non return valve hot water
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
RM2	Non return valve heat system
*	Components not delivered by Qvantum


COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

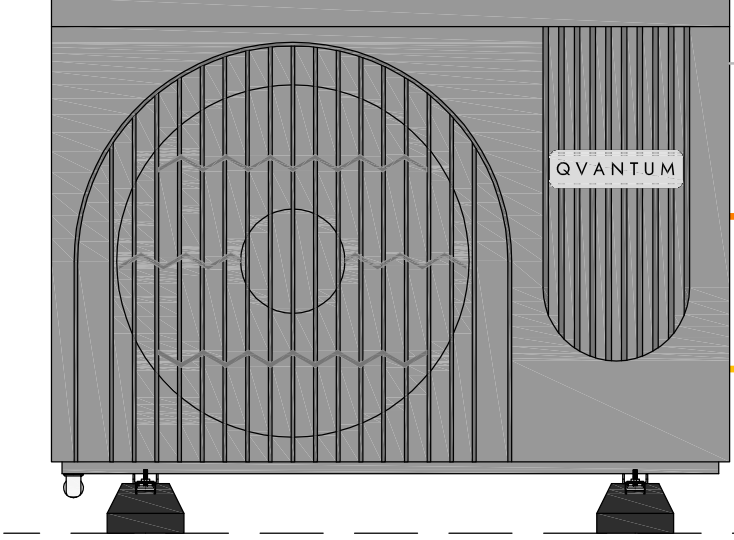

QVANTUM QH175

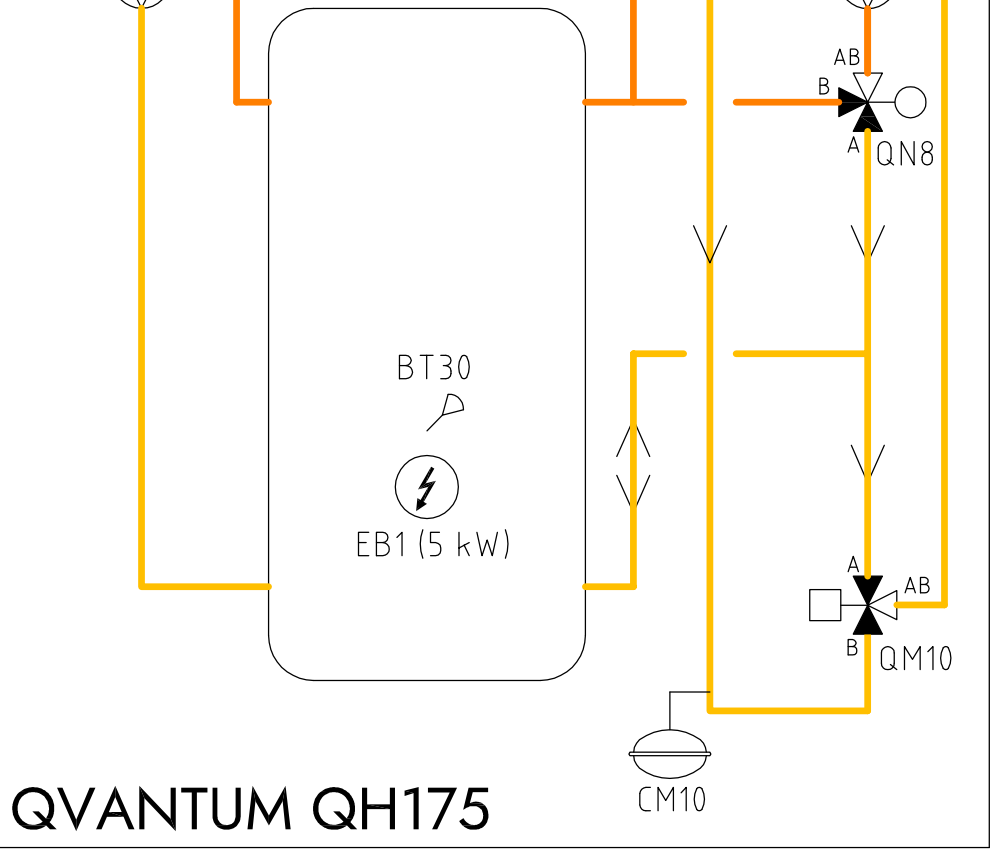

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-009	PAGE NUMBER 12
-----------------------	--	--------------------------

Information

QA9/15 & QH175, heating & hot water, external circulation pump, second heating system

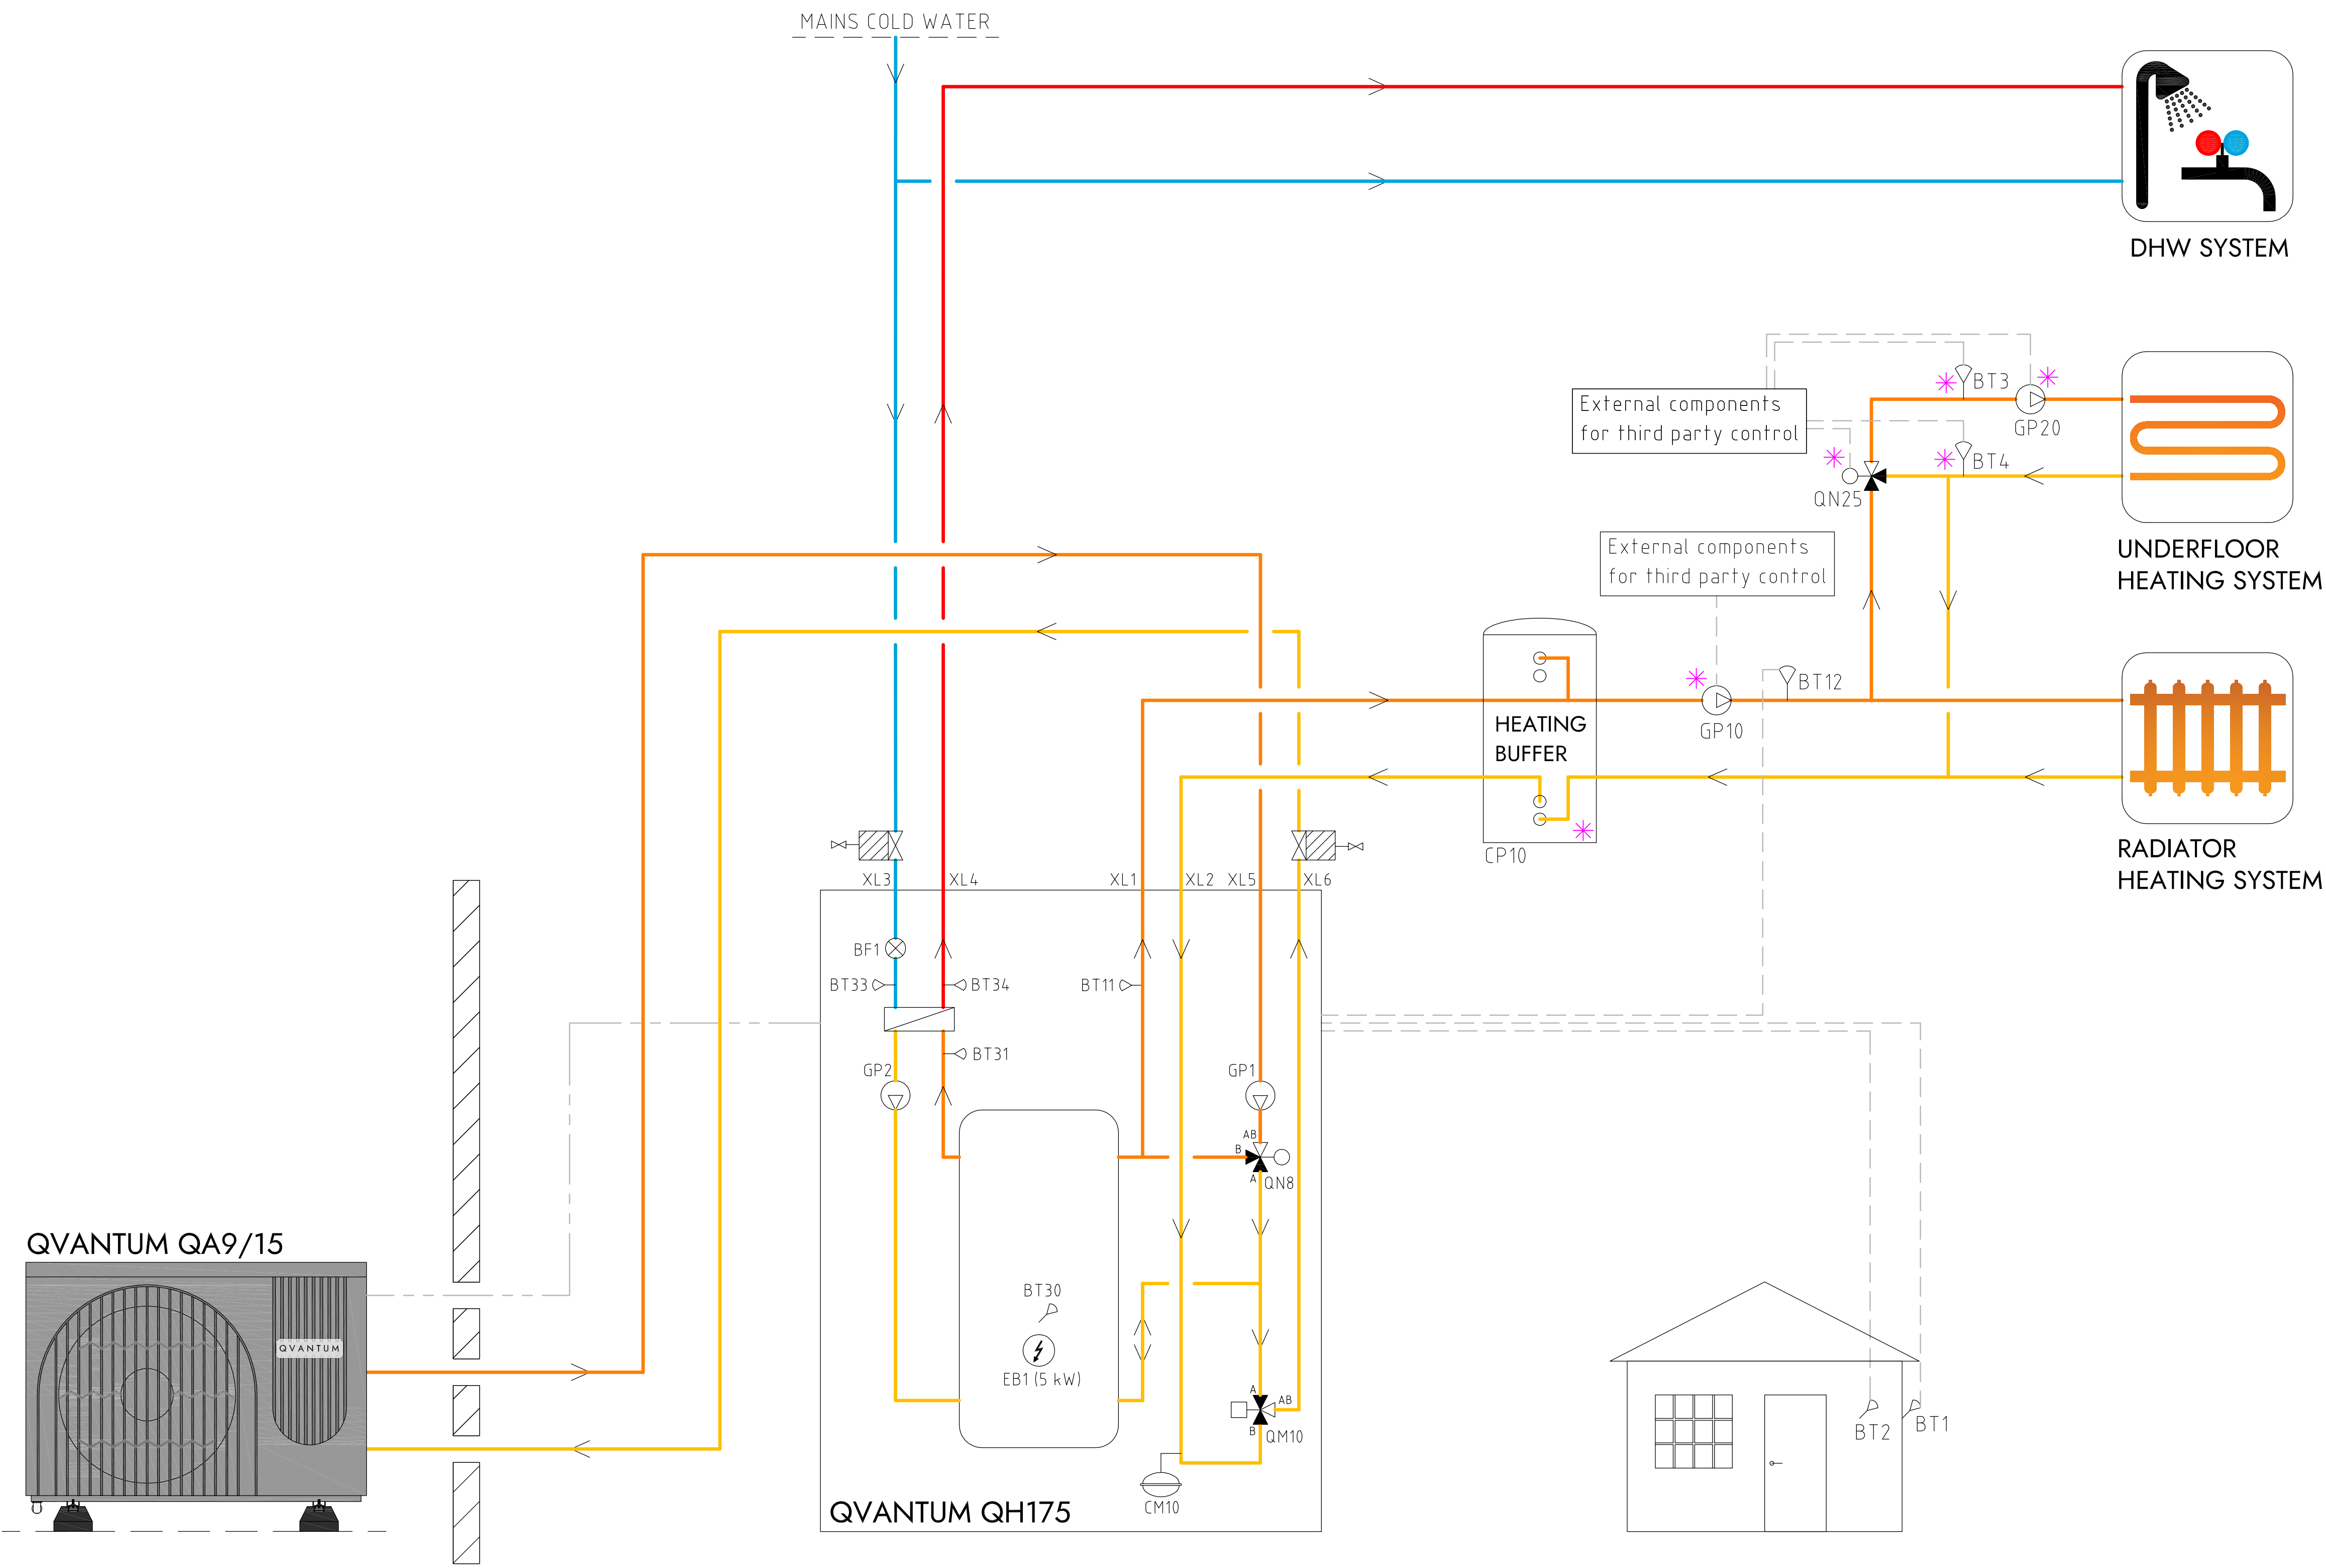

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.


Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-010	PAGE NUMBER 13
----------------	-----------------------------------	-------------------

Information

QA9/15 & QH175, heating & hot water with external hot water tank, external circulation pump, second heating system

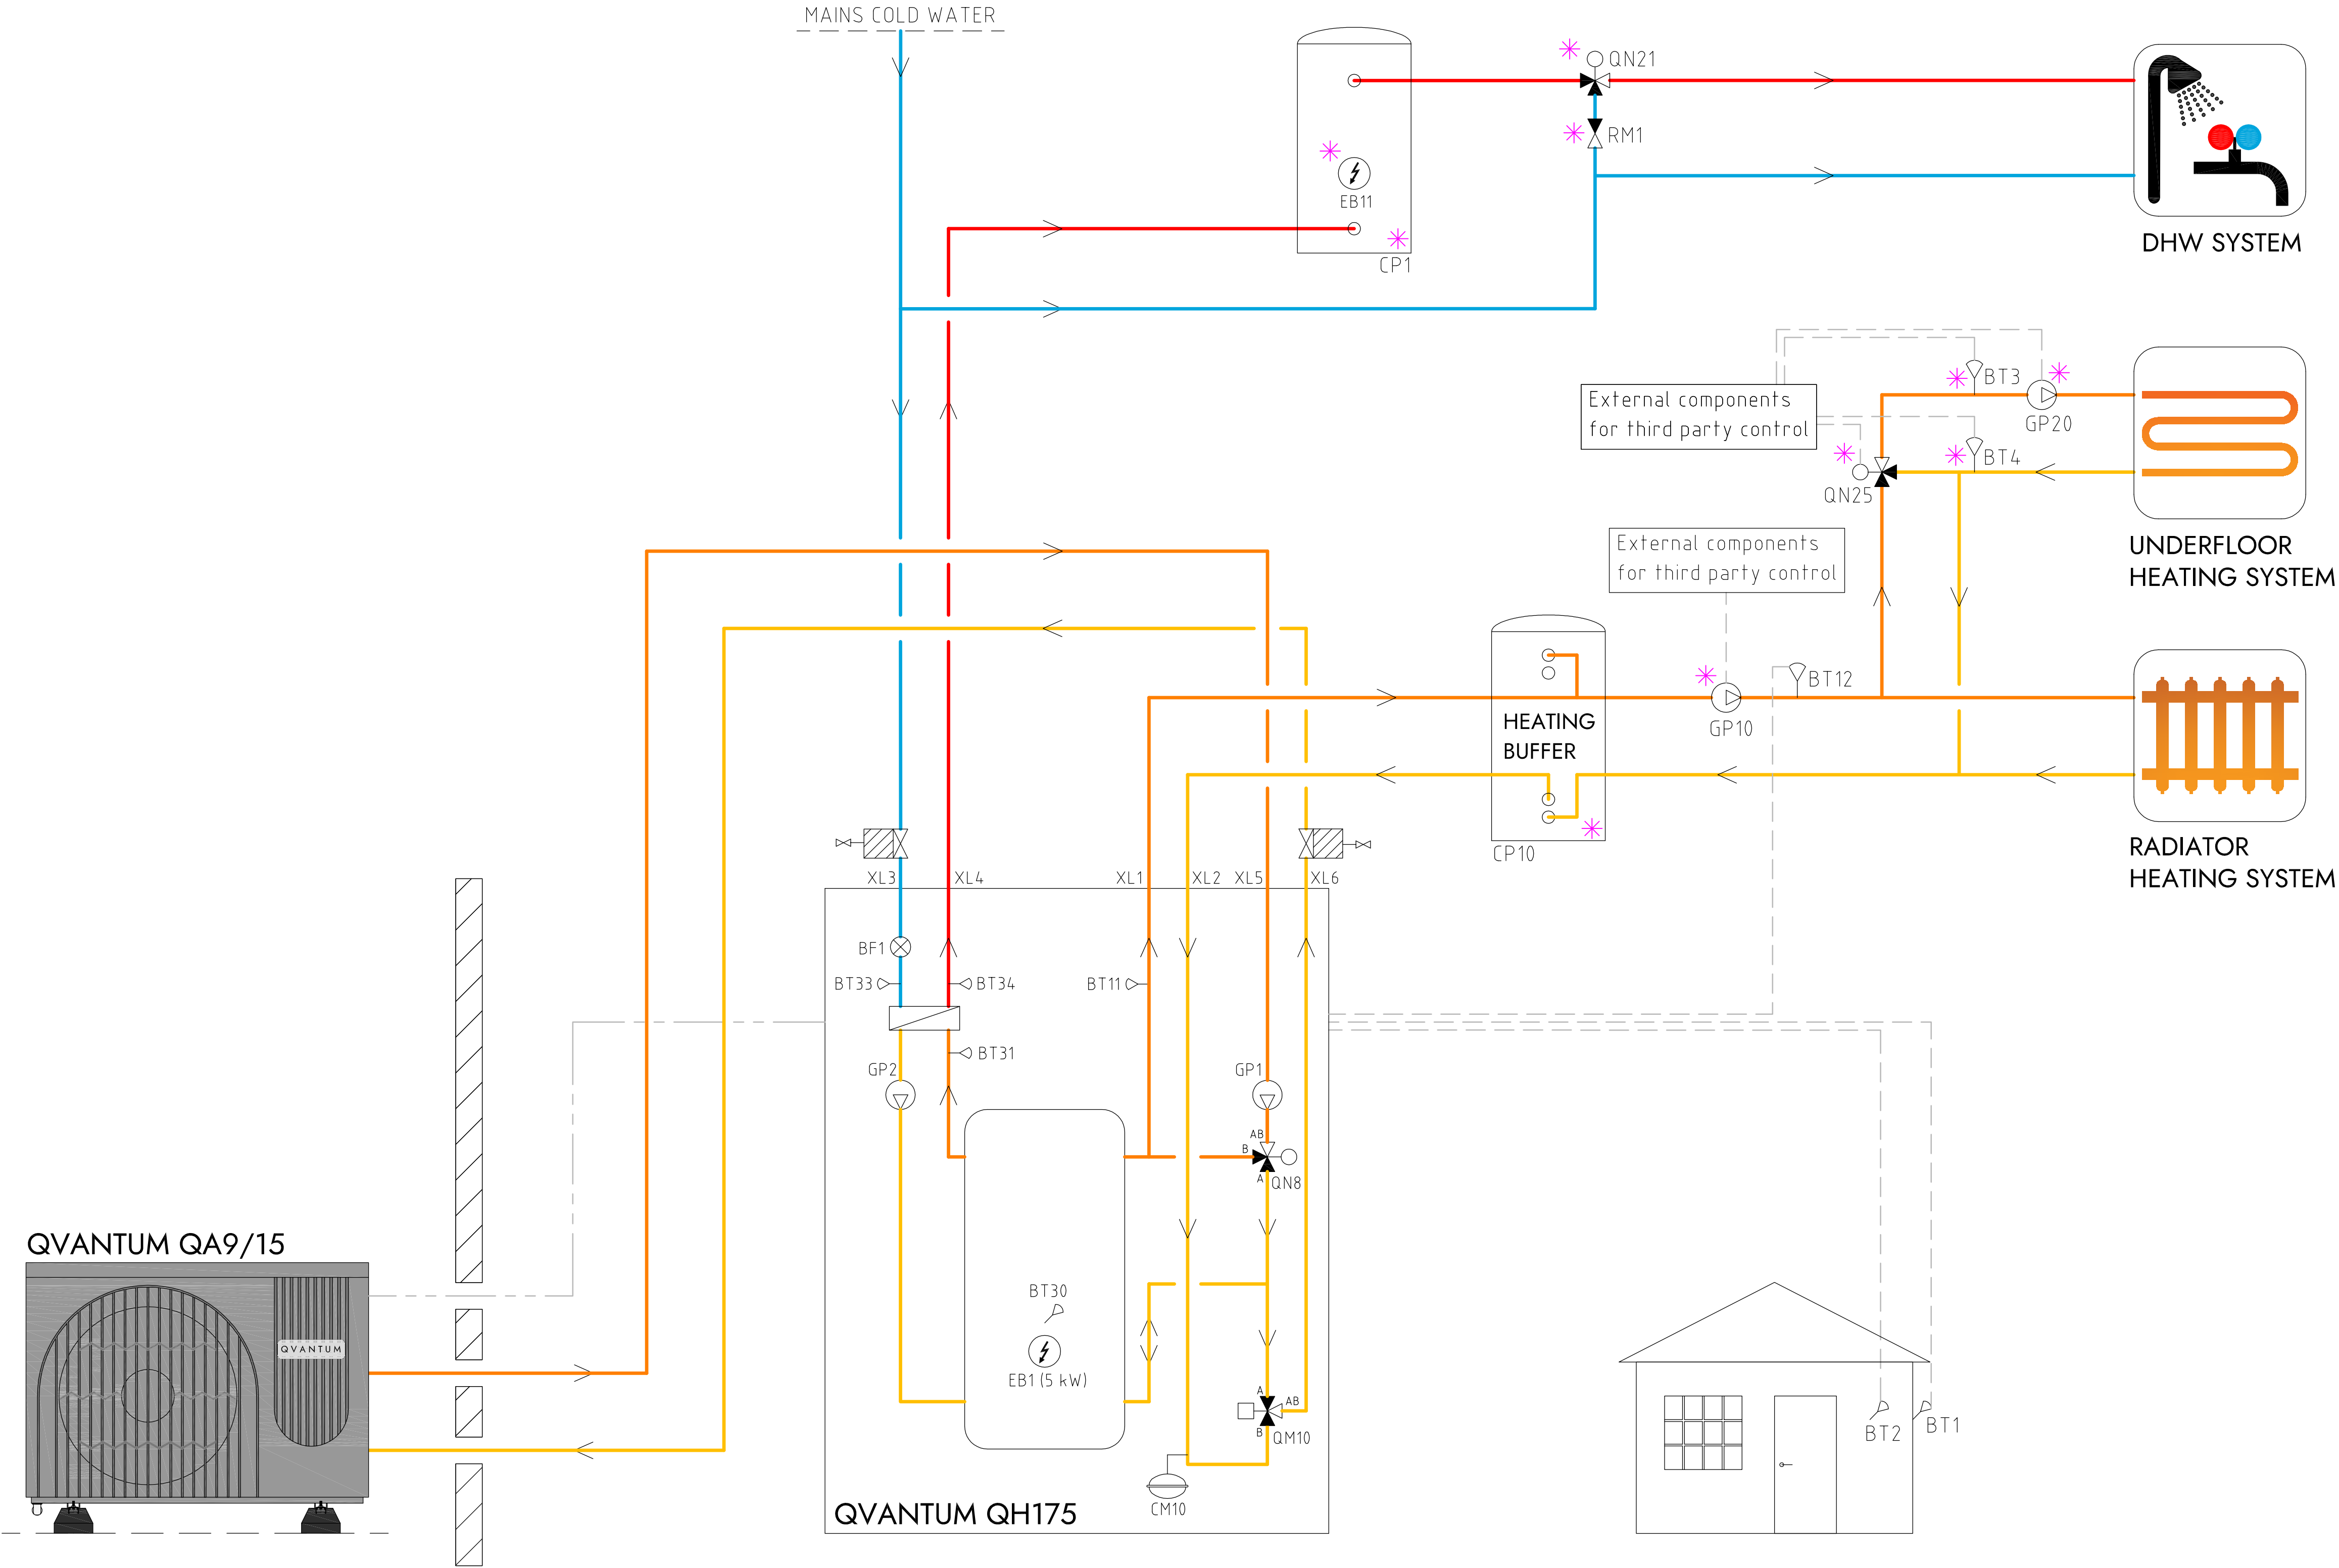


COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
CP1	DHW cylinder
EB11	Immersion heater
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

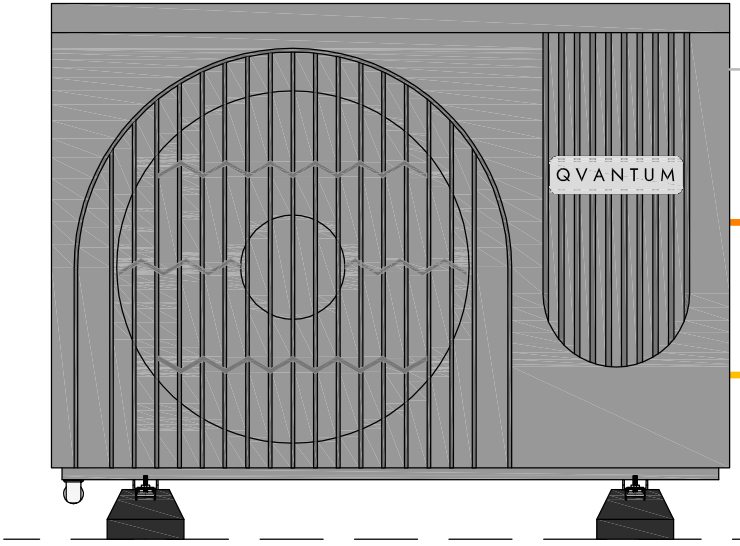

QVANTUM QH175



Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.

Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp


DRAWN BY
JE

DRAWING NUMBER
QA9:15-56-8-011

PAGE NUMBER
14

Information

QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, external circulation pump, second heating system

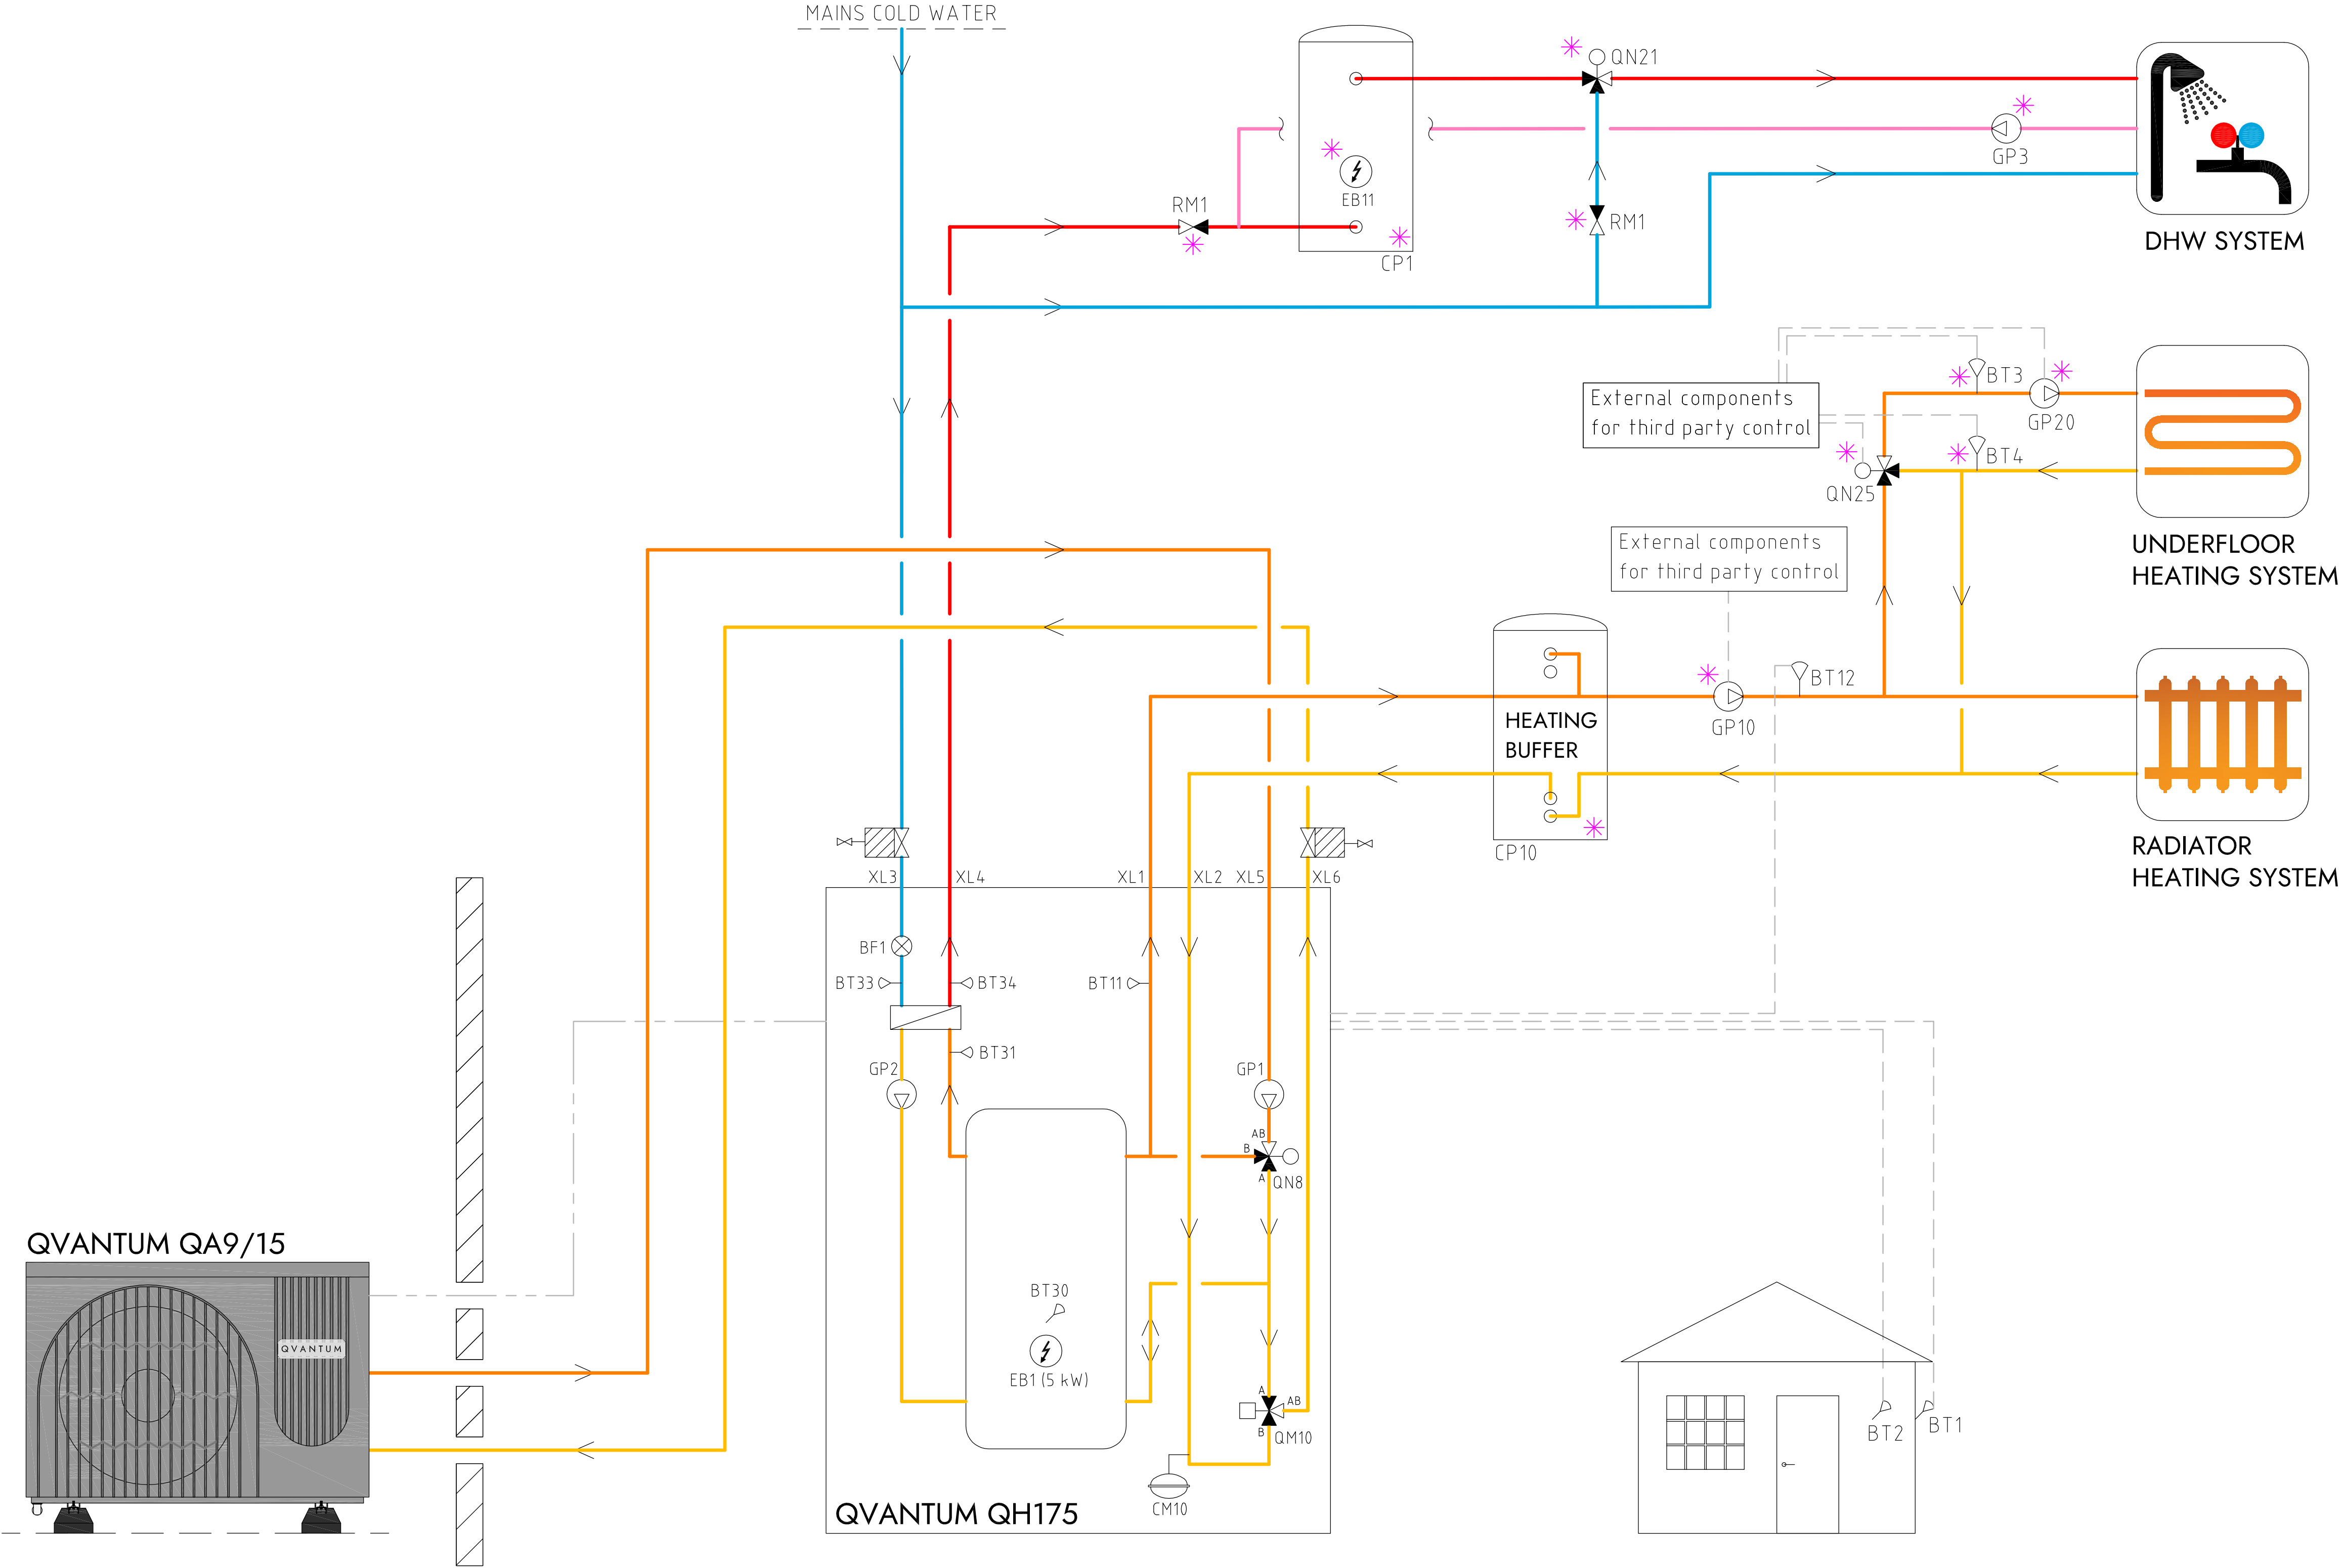

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
GP3	DHW circulation pump
CP1	DHW cylinder
EB11	Immersion heater
RM1	Non return valve hot water
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QN25	Shunt valve, sec heat system
GP20	Circulation pump, sec heat system
BT3	Heating flow, sec heat system
BT4	Heating return, sec heat system
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




QVANTUM
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-012	PAGE NUMBER 15
-----------------------	--	--------------------------

Information

QA9/15 & QH175, heating & hot water, external circulation pump, individual zone control

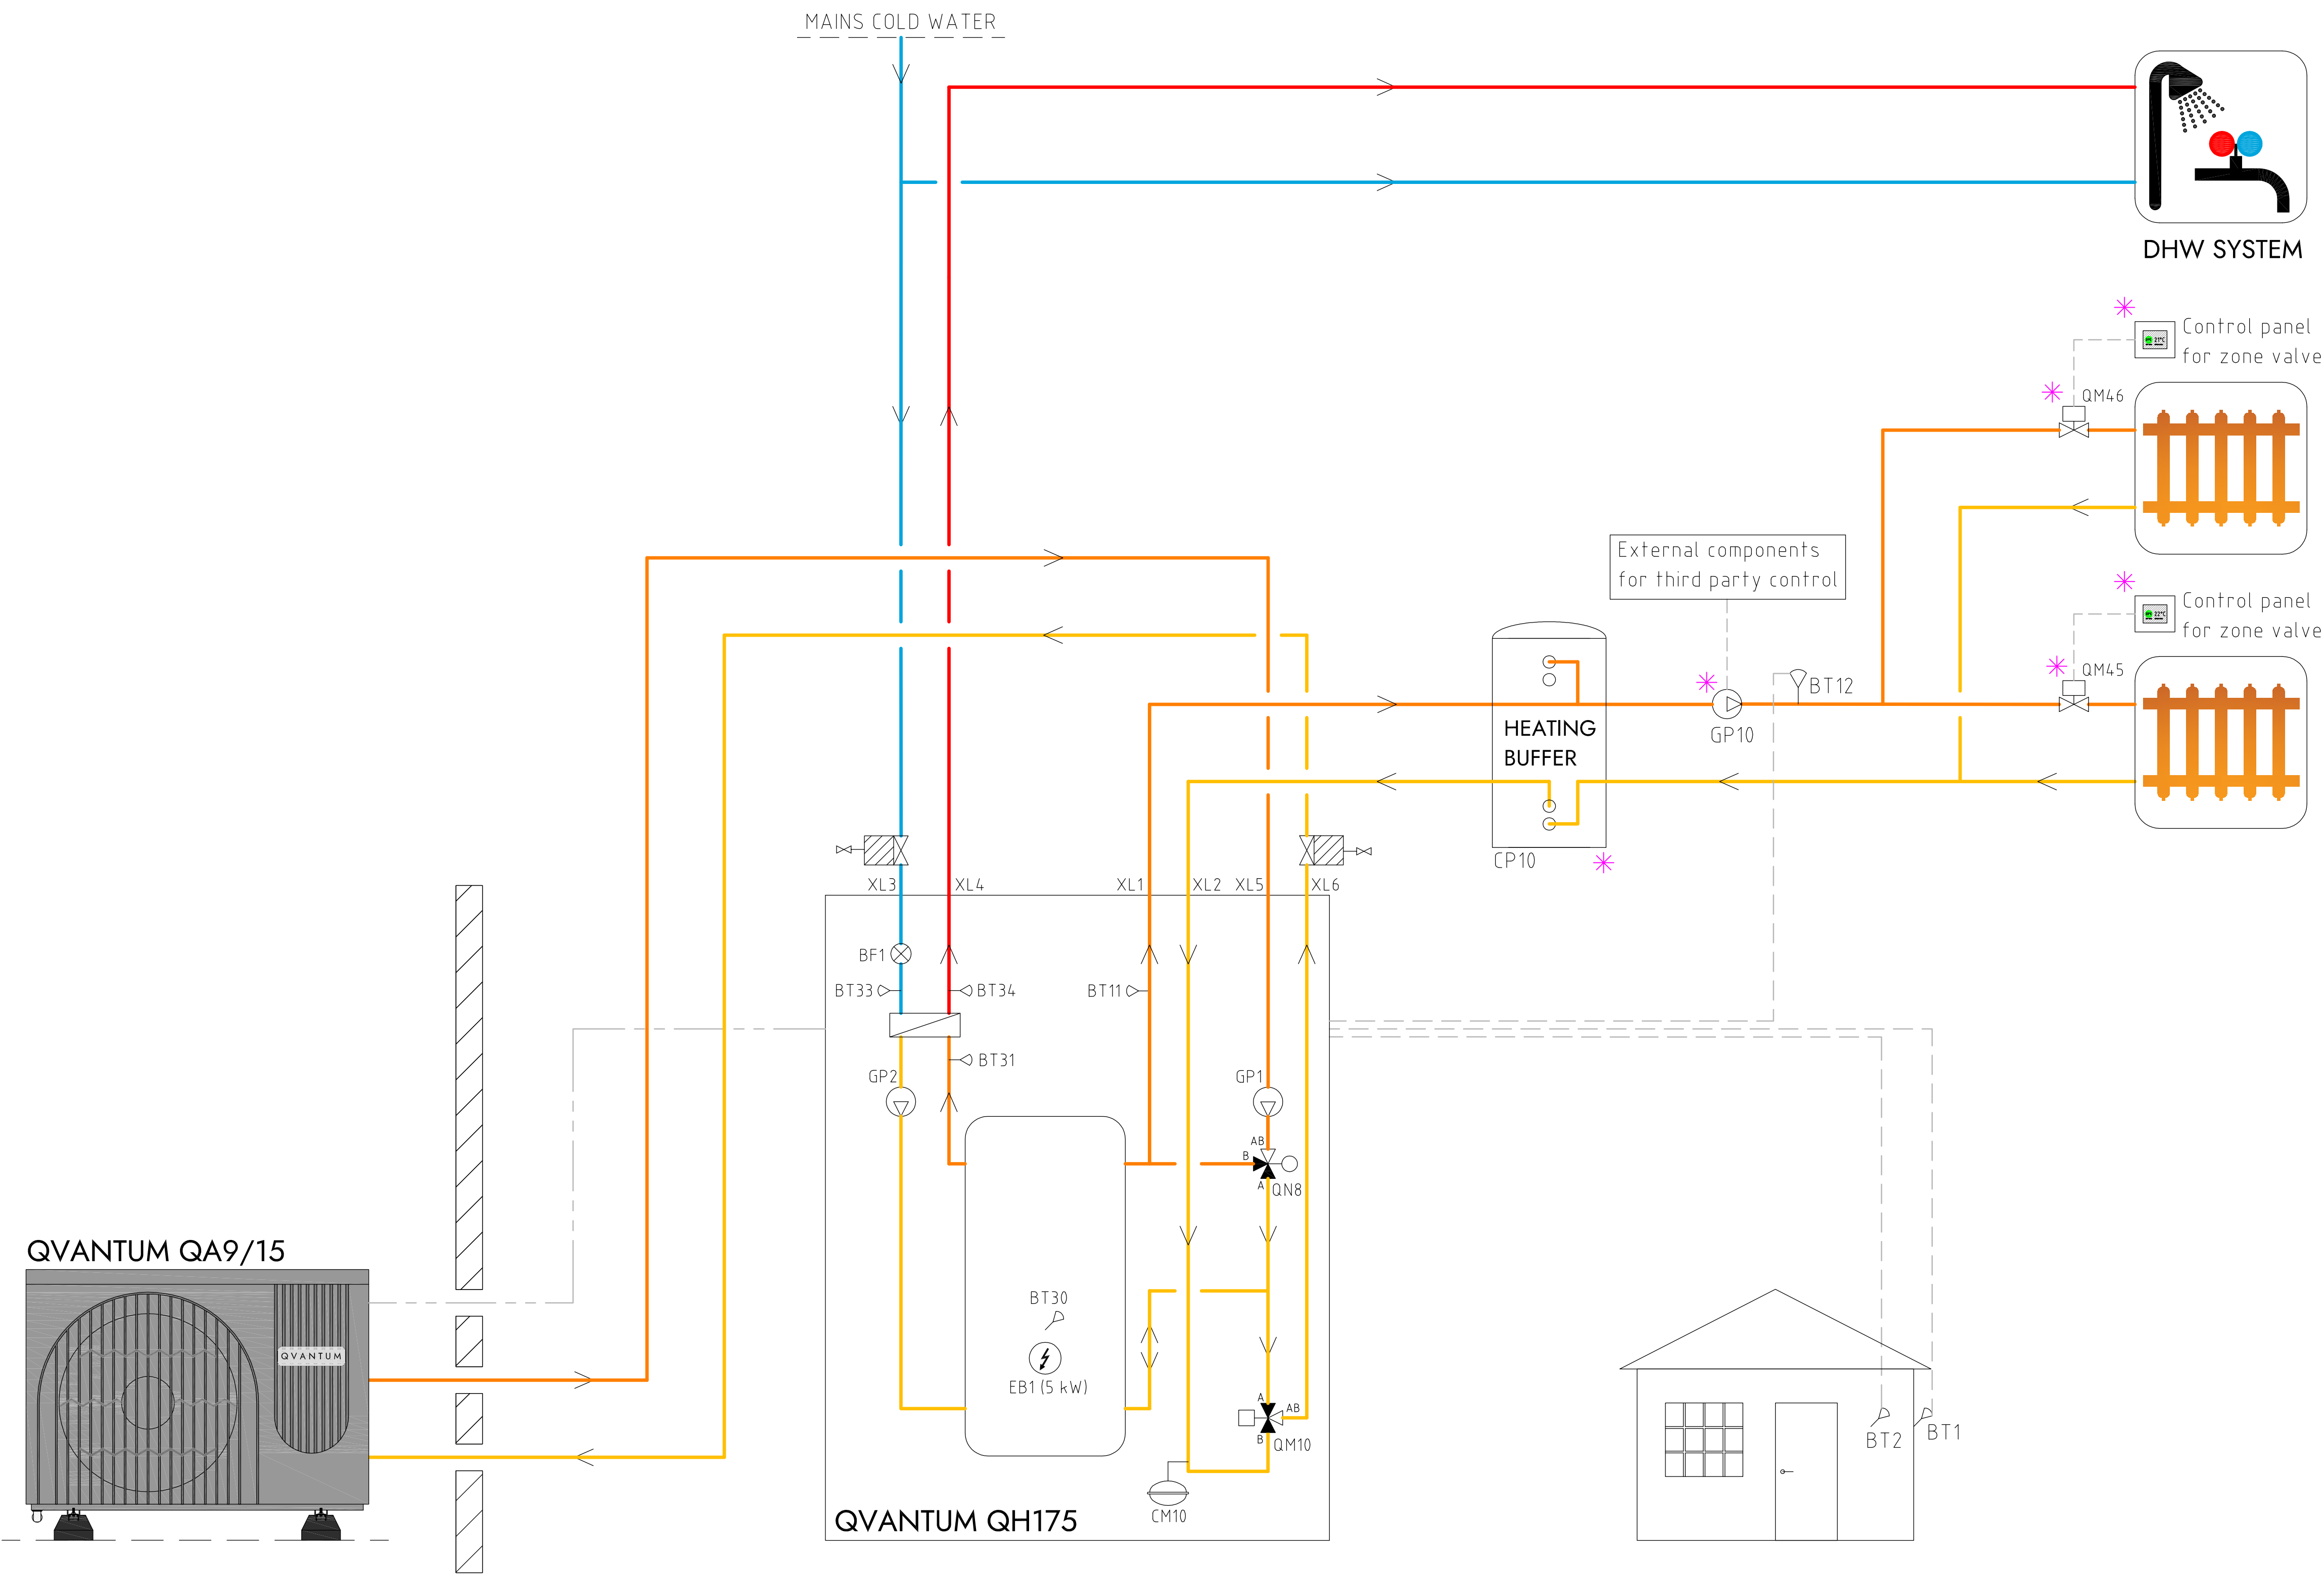

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QM45	Zone valve
QM46	Zone valve
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.




Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-56-8-013	PAGE NUMBER 16
-----------------------	--	--------------------------

Information

QA9/15 & QH175, heating & hot water with external hot water tank, external circulation pump, individual zone control

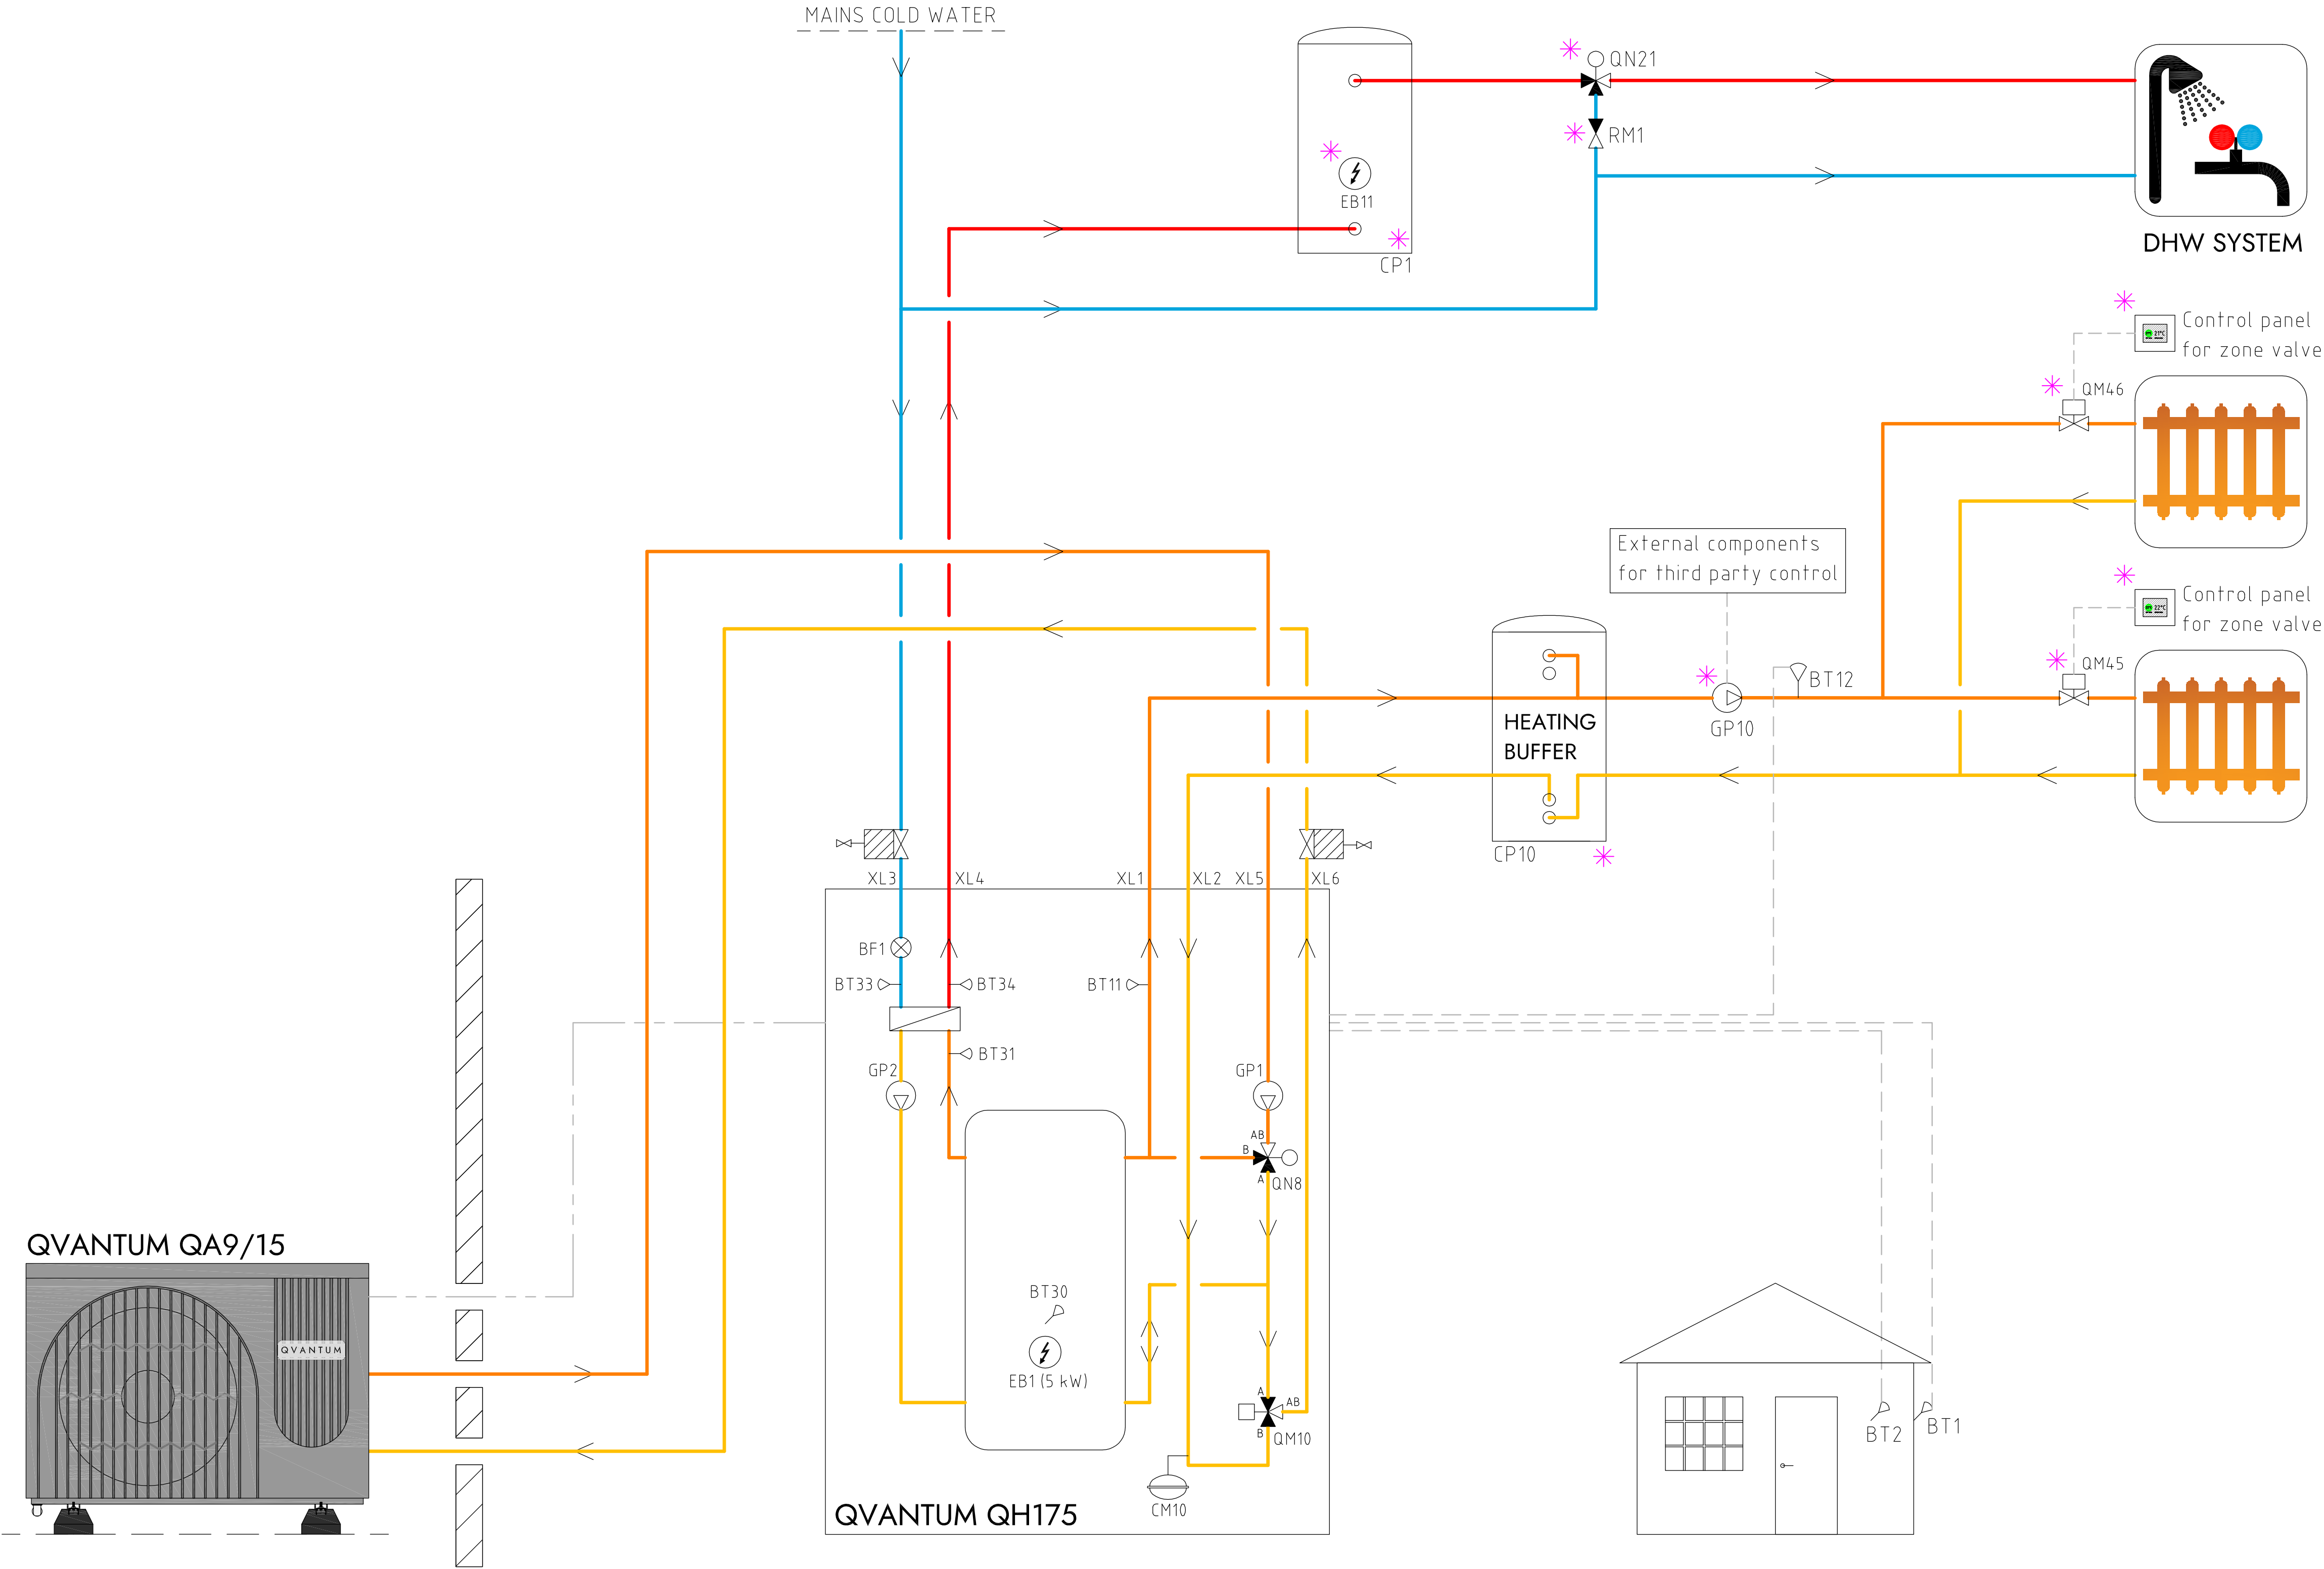

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
CP1	DHW cylinder
EB11	Immersion heater
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QM45	Zone valve
QM46	Zone valve
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.

Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp


DRAWN BY
JE

DRAWING NUMBER
QA9:15-56-8-014

PAGE NUMBER
17

Information

QA9/15 & QH175, heating & hot water with external hot water tank & hot water circulation, individual zone control

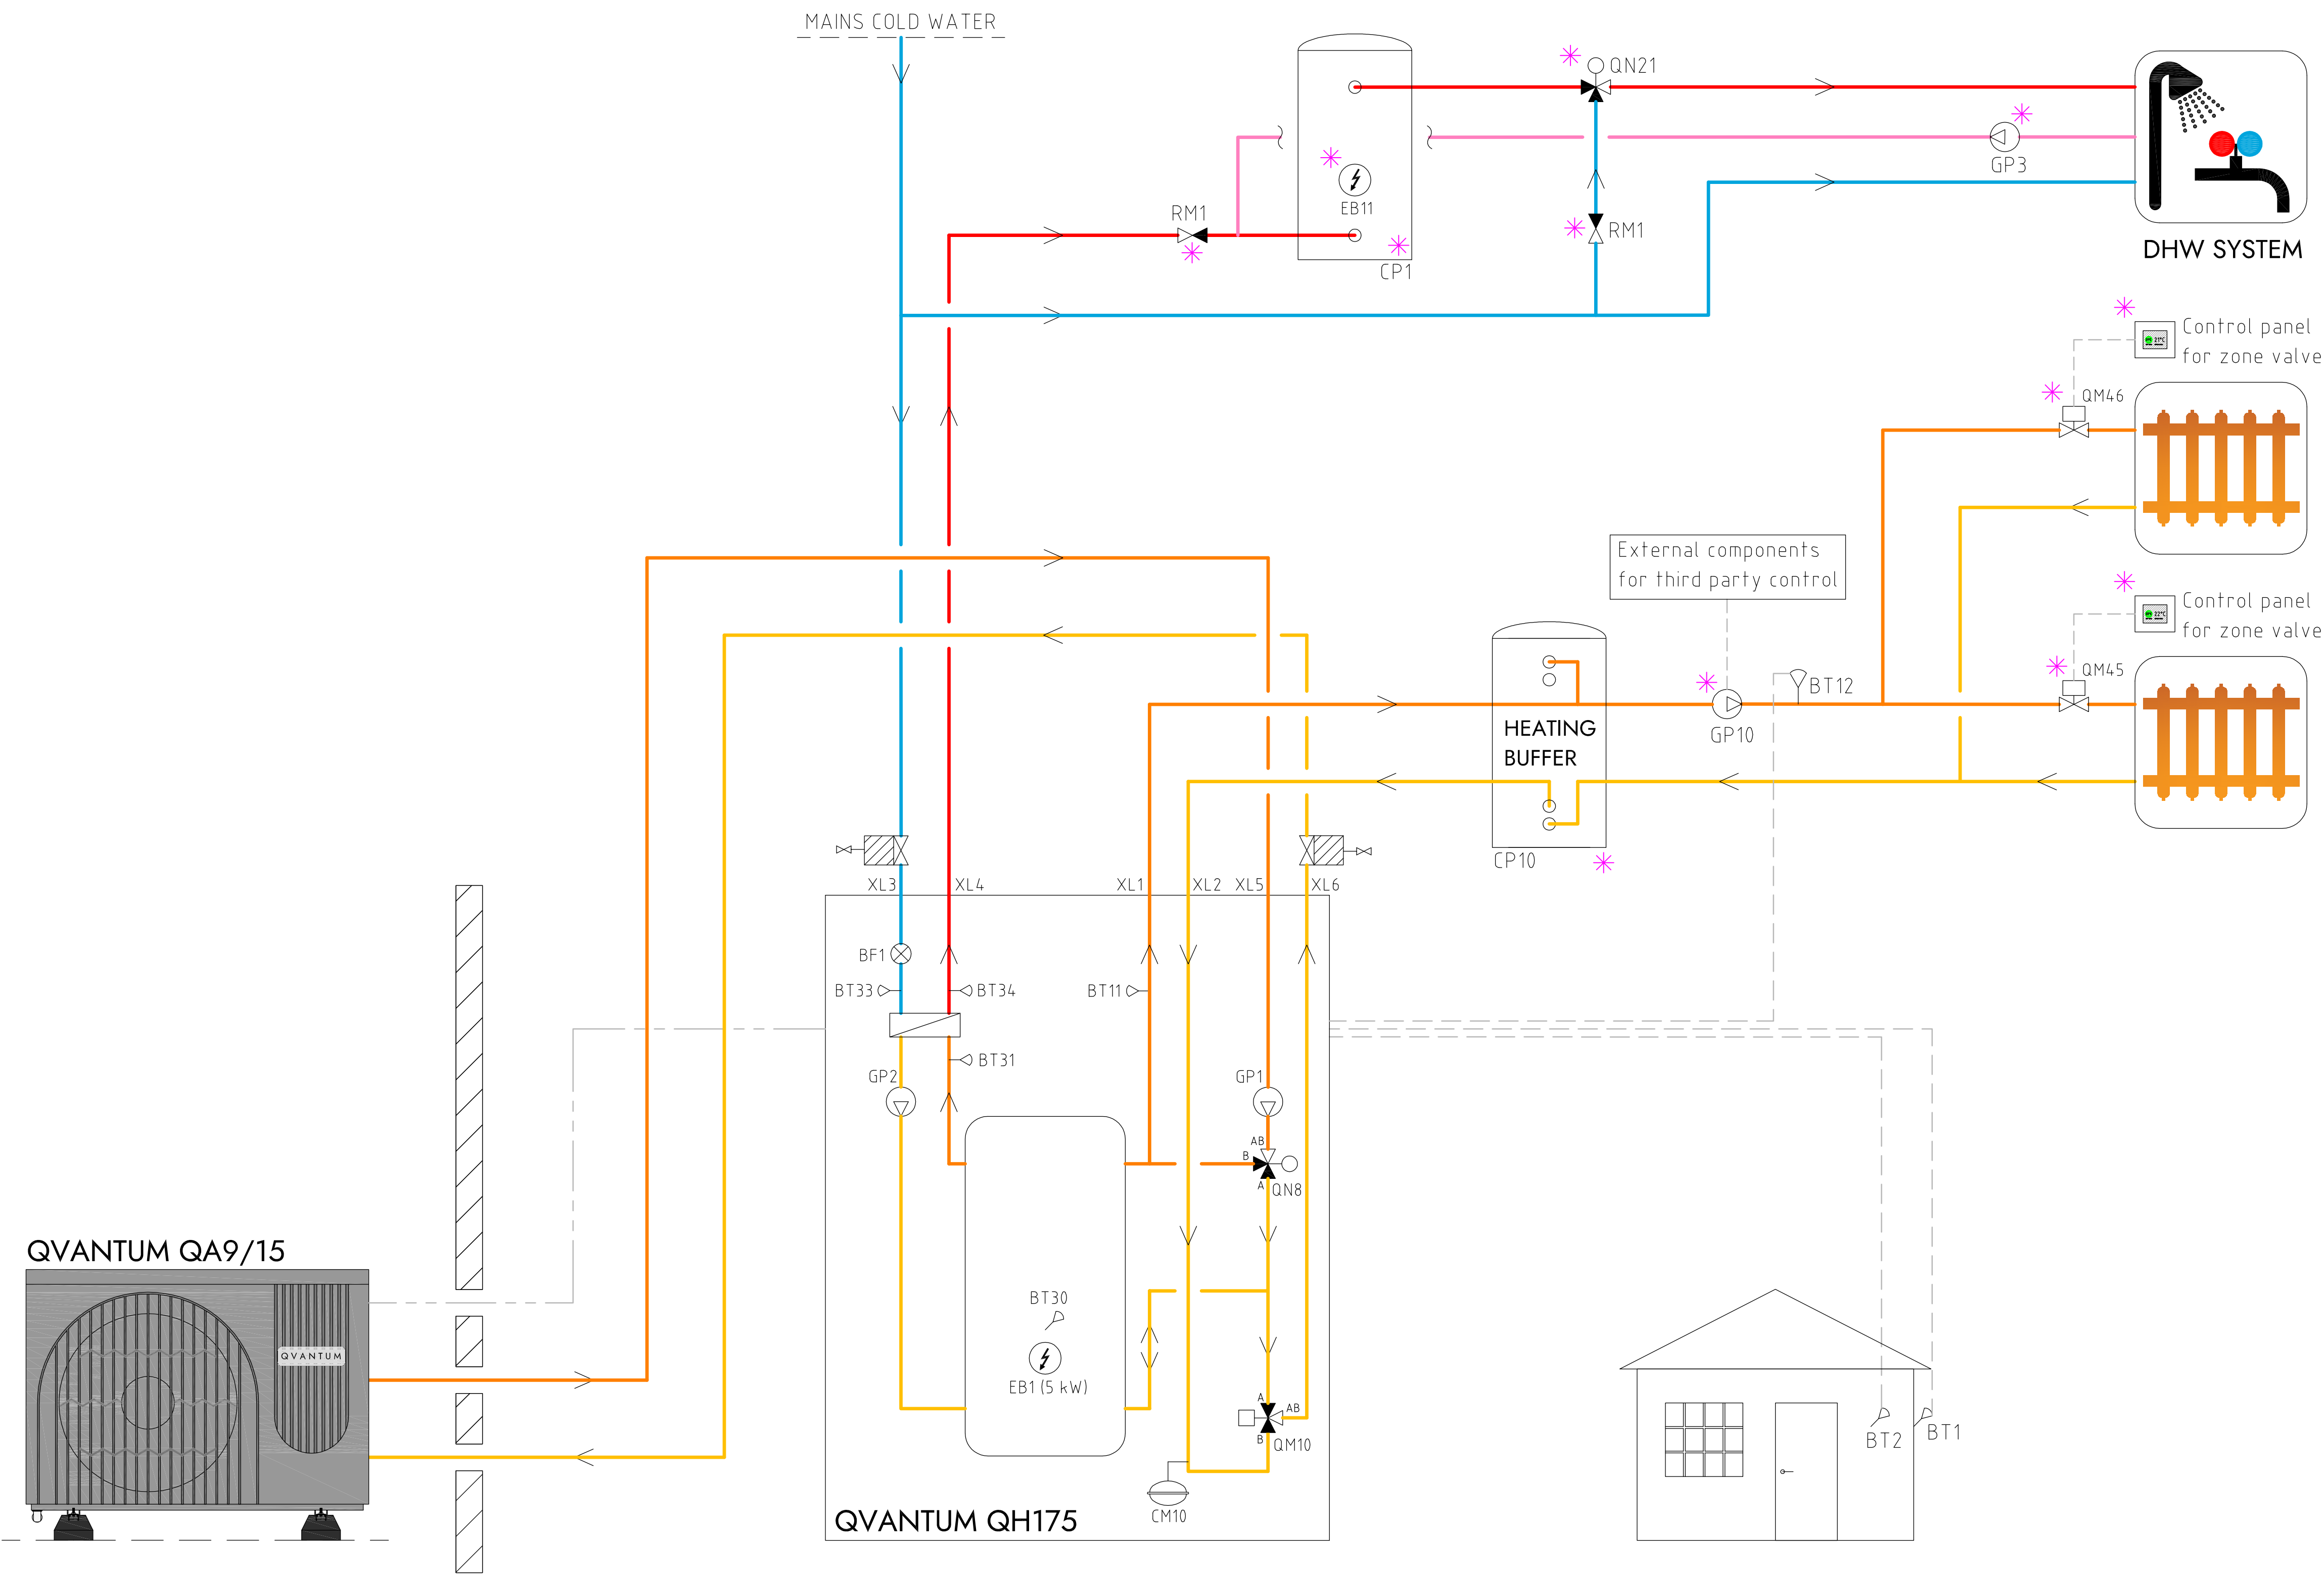


COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
QN21	Thermostatic mixing valve (35-60°C)
GP3	DHW circulation pump
CP1	DHW cylinder
EB11	Immersion heater
RM1	Non return valve hot water
BT12	External flow temperature
GP10	External circulation pump, heating
CP10	Heating buffer
QM45	Zone valve
QM46	Zone valve
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

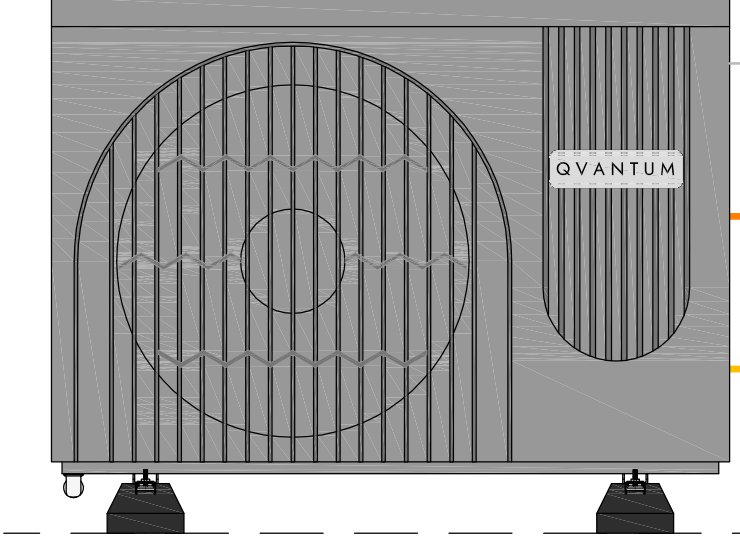

QVANTUM QH175

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.

Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp


DRAWN BY
JE

DRAWING NUMBER
QA9:15-56-8-015

PAGE NUMBER
18

Information

QA9/15 & QH175, 2-pipe cooling
& hot water

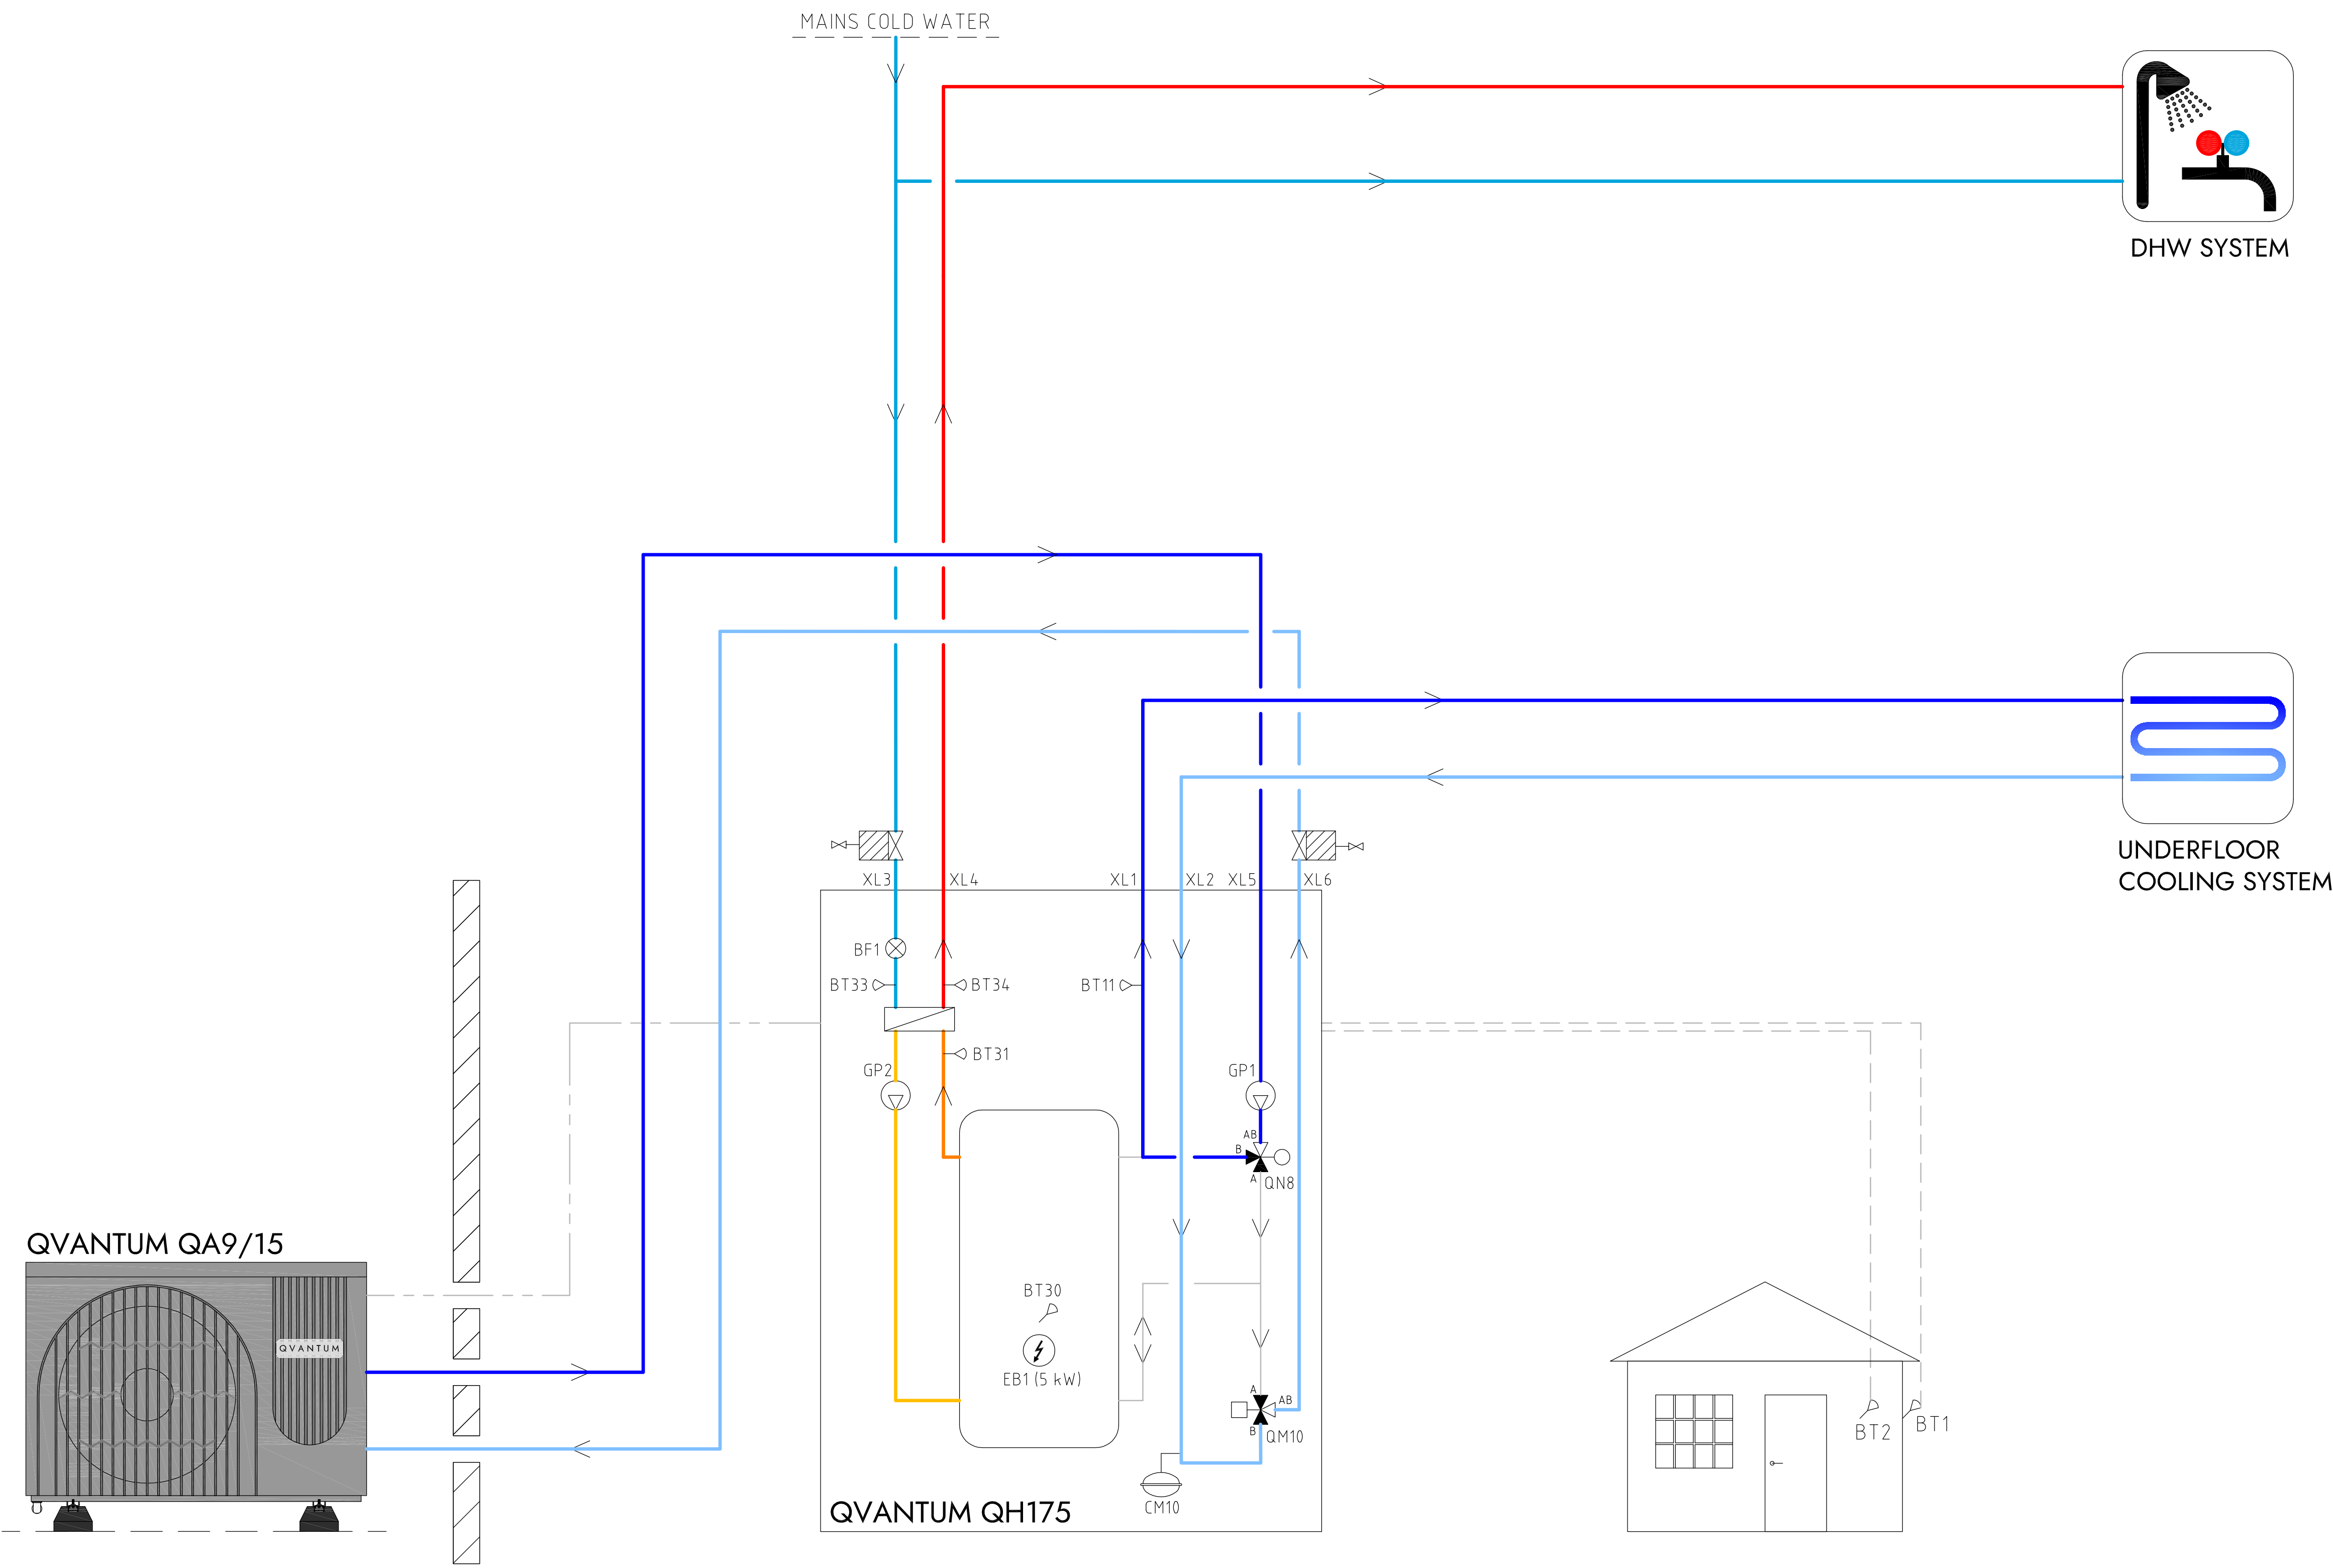

COMPONENT DESIGNATIONS

QM10	Diverting valve
QN8	Shunt valve
EB1	Immersion heater
GP1	Circulation pump heating
GP2	Circulation pump hot water
CM10	Expansion vessel
BT1	Outdoor sensor
BT2	Room sensor
BT11	Heating flow temperature
BT30	Tank temperature
BT31	Plate HX inlet
BT33	Cold water inlet
BT34	Hot water outlet
BF1	Flow sensor
*	Components not delivered by Qvantum

COMPONENT SYMBOLS

	Circulation pump
	Temperature sensor
	3-way control valve
	Isolation valve
	Non return valve
	Strainer

QVANTUM QA9/15

QVANTUM QH175

UNDERFLOOR
COOLING SYSTEM

DHW SYSTEM

Please note

- This hydraulic schematic is a non-binding, schematic proposal for the hydraulic integration of the QA & QH units.
- This hydraulic schematic does not replace professional planning and implementation, all applicable laws, standards, and regulations must be adhered to.
- The representation of safety devices is not complete.
- Fittings and safety devices outside the QA & QH units area are not included and must be provided and installed on site.



Q V A N T U M
HEAT PUMPS FOR SUSTAINABLE CITIES

QVANTUM ENERGI AB
Ji-te gatan 7, 265 38 Åstorp

DRAWN BY JE	DRAWING NUMBER QA9:15-55-8-001	PAGE NUMBER 19
-----------------------	--	--------------------------